



Preliminary Storm Drainage Report

FOR

Bullfrog – Phase S-2
Cle Elum, Washington



2024-11-14

Prepared for: Bullfrog Flats, LLC
18300 Redmond Way, Suite 120
Redmond, WA 98052

Project Manager: Holli Heavrin, P.E.
Approved by: Quentin Chalmers, P.E.
Prepared by: Katie Lane, E.I.T.
Date: November 14, 2024
Core No: 24019



12100 NE 195th Street, Suite 300
Bothell, Washington 98011
Ph 425.885.7877
www.coredesigninc.com

Table of Contents

1. Project Overview	1-1
2. Conditions and Requirement Summary	2-1
2.1 Core Elements.....	2-1
2.1.1 Core Element #1: Preparation of a Stormwater Site Plan.....	2-1
2.1.2 Core Element #2: Construction Stormwater Pollution Prevention.....	2-1
2.1.3 Core Element #3: Source Control of Pollution	2-1
2.1.4 Core Element #4: Preservation of Natural Drainage Systems.....	2-1
2.1.5 Core Element #5: Runoff Treatment	2-1
2.1.6 Core Element #6: Flow Control	2-2
2.1.7 Core Element #7: Operation and Maintenance	2-2
2.1.8 Core Element #8: Wetlands Protection	2-2
2.2 Additional Protective Measures (APMs).....	2-2
2.2.1 APM1: Financial Liability	2-2
2.2.2 APM2: Off-Site Analysis Report.....	2-2
2.2.3 APM3: Local Requirements.....	2-2
3. Off-Site Analysis.....	3-1
4. Permanent Stormwater Control Analysis and Design	4-1
4.1 Stormwater Design Overview	4-1
4.2 Basin Information.....	4-1
4.3 Bioretention Design	4-1
4.3.2 Modeling Results	4-2
4.4 Infiltration Pond Design	4-2
4.4.1 Snowmelt Adjustment Factor Calculation.....	4-2
4.4.2 Design Storm	4-3
4.4.3 Modeling Results	4-4
5. Construction Stormwater Pollution Prevention Analysis.....	5-1
6. Operations and Maintenance Manual	6-1

Table of Figures

Figure 1-1 Vicinity Map	1-1
-------------------------------	-----

Table of Tables

Table 4-1 Basin Areas.....	4-1
Table 4-2 Bioretention Design Information	4-2
Table 4-3 Average Daily Snow Depth Calculation.....	4-3
Table 4-4 Snowmelt Adjustment Factors as adopted from the 2024 SWMMEW	4-3
Table 4-5 Design Storm Calculation	4-3
Table 4-6 Infiltration Pond Design Geometry	4-4

Table of Appendices

Appendix A. Bioretention Water Quality HydroCAD Reports	
Appendix B. Overall HydroCAD Reports	
Appendix C. S-1 Center Pond HydroCAD Report	

1. Project Overview

The Bullfrog project is a mixed-use phased development project located in the western portion of the City of Cle Elum, between Bullfrog Road and SR 903. This report addresses the stormwater design for Phase S-2 of this project. Phase S-2 will consist of single family detached residential development resulting in 130 individual lots. Phase S-2 is located within the southeast region of the overall development, with future phase J to the northwest, Phase S-1 to the west, future phase B to the northeast, and the Washington State Horse Park to the southeast. See Figure 1-1 below for reference.

The existing site of Phase S-2 generally slopes from northwest to southeast at slopes ranging between 1 and 30 percent.

All runoff from the site infiltrates prior to leaving the site in the present state, and this will be maintained post development. Basic water quality treatment will be provided by infiltration through bioretention soil mix. Stormwater management and facilities have been designed per the 2024 Stormwater Management Manual for Eastern Washington (SWMMMEW).

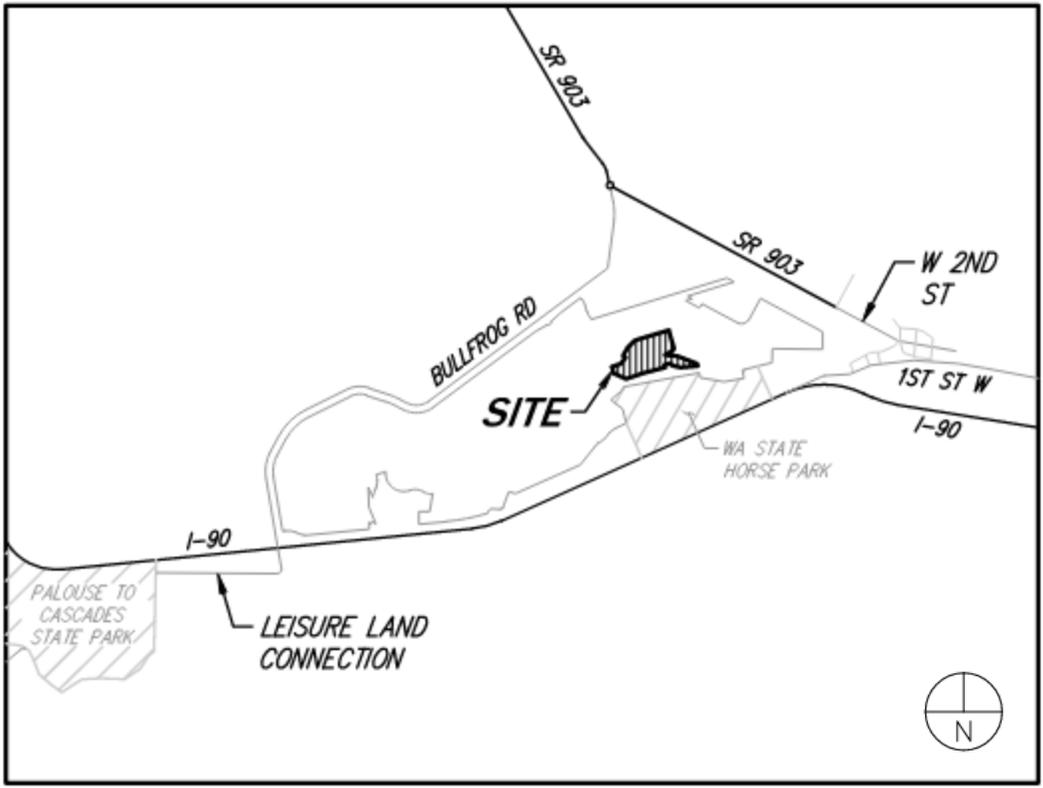


Figure 1-1 Vicinity Map

2. Conditions and Requirement Summary

This project is considered a new development project and proposes greater than 5,000 square feet of new plus replaced hard surfaces; therefore, per Figure 2.1 of the SWMMEW, provided at the end of this section, Phase S-1 is subject all Core Elements.

2.1 Core Elements

2.1.1 Core Element #1: Preparation of a Stormwater Site Plan

This report, along with the civil plans submitted under separate cover, will satisfy this core element.

2.1.2 Core Element #2: Construction Stormwater Pollution Prevention

In order to reduce the impacts of sediment laden runoff during construction, a Construction Stormwater Pollution Prevention Plan (CSWPPP) will be prepared for this project and included under separate cover at final design. This plan will address the 13 elements of pollution prevention and the appropriate BMPs which will be implemented to ensure the prevention of sediment laden runoff from leaving the site. Section 5 of this report will also provide an overview of the measures being taken to address this element at final design.

2.1.3 Core Element #3: Source Control of Pollution

Development of the project site consists of single family residential development and associated roads and utilities. Per Section 8.1 of the 2024 SWMMEW, this level of development is not required to implement Source Control BMPs. As such, this element is considered to have been addressed.

2.1.4 Core Element #4: Preservation of Natural Drainage Systems

Onsite natural drainage patterns consist of infiltration of runoff. The project proposes to mimic this condition. In doing such, the project will maintain the natural drainage outfall to the maximum extent practicable. See Section 3 of this report for a discussion of the existing outfall.

2.1.5 Core Element #5: Runoff Treatment

Runoff treatment for the project has been evaluated in accordance with the 2024 SWMMEW based on the location of project site discharge. Project site discharge is proposed to be through surface infiltration, and oil control is not required for the proposed level of development. As such, runoff treatment will be accomplished by filtering through bioretention soil mix prior to surface infiltration. This will occur at a bioretention facility for each drainage basin, the design of which is discussed further in Section 4.3 of this report.

2.1.6 Core Element #6: Flow Control

Flow control is required for the project site and will be provided through the use of infiltration BMPs, designed to infiltrate 100 percent of the 25-year, 24-hour Type IA storm. Additional information regarding the proposed facilities is included in Section 4 of this report.

2.1.7 Core Element #7: Operation and Maintenance

Appropriate Operations and Maintenance (O&M) information for the proposed stormwater management BMPs will be provided at final design in Section 6 of this report.

2.1.8 Core Element #8: Wetlands Protection

Stormwater discharge from the project site will be via onsite infiltration, matching the existing condition. Therefore, stormwater discharge from the site does not discharge into a wetland directly or via a conveyance system, and Core Element #8 is not applicable.

2.2 Additional Protective Measures (APMs)

The City of Cle Elum does not require the APMs to be applied to project development. However, the project has reviewed the requirements as discussed below, for applicability and relevance.

2.2.1 APM1: Financial Liability

Bonding for the project will be determined at final design and per instruction from the City at that time.



2.2.2 APM2: Off-Site Analysis Report

Section 3 of this report provides discussion of the natural drainage patterns of the project site. In the existing condition, all runoff infiltrates on site. Therefore, an offsite analysis is not required.

2.2.3 APM3: Local Requirements

No additional Local Requirements per the City of Cle Elum are required.


Figure 2.1: Flow Chart for Determining Requirements for New Development

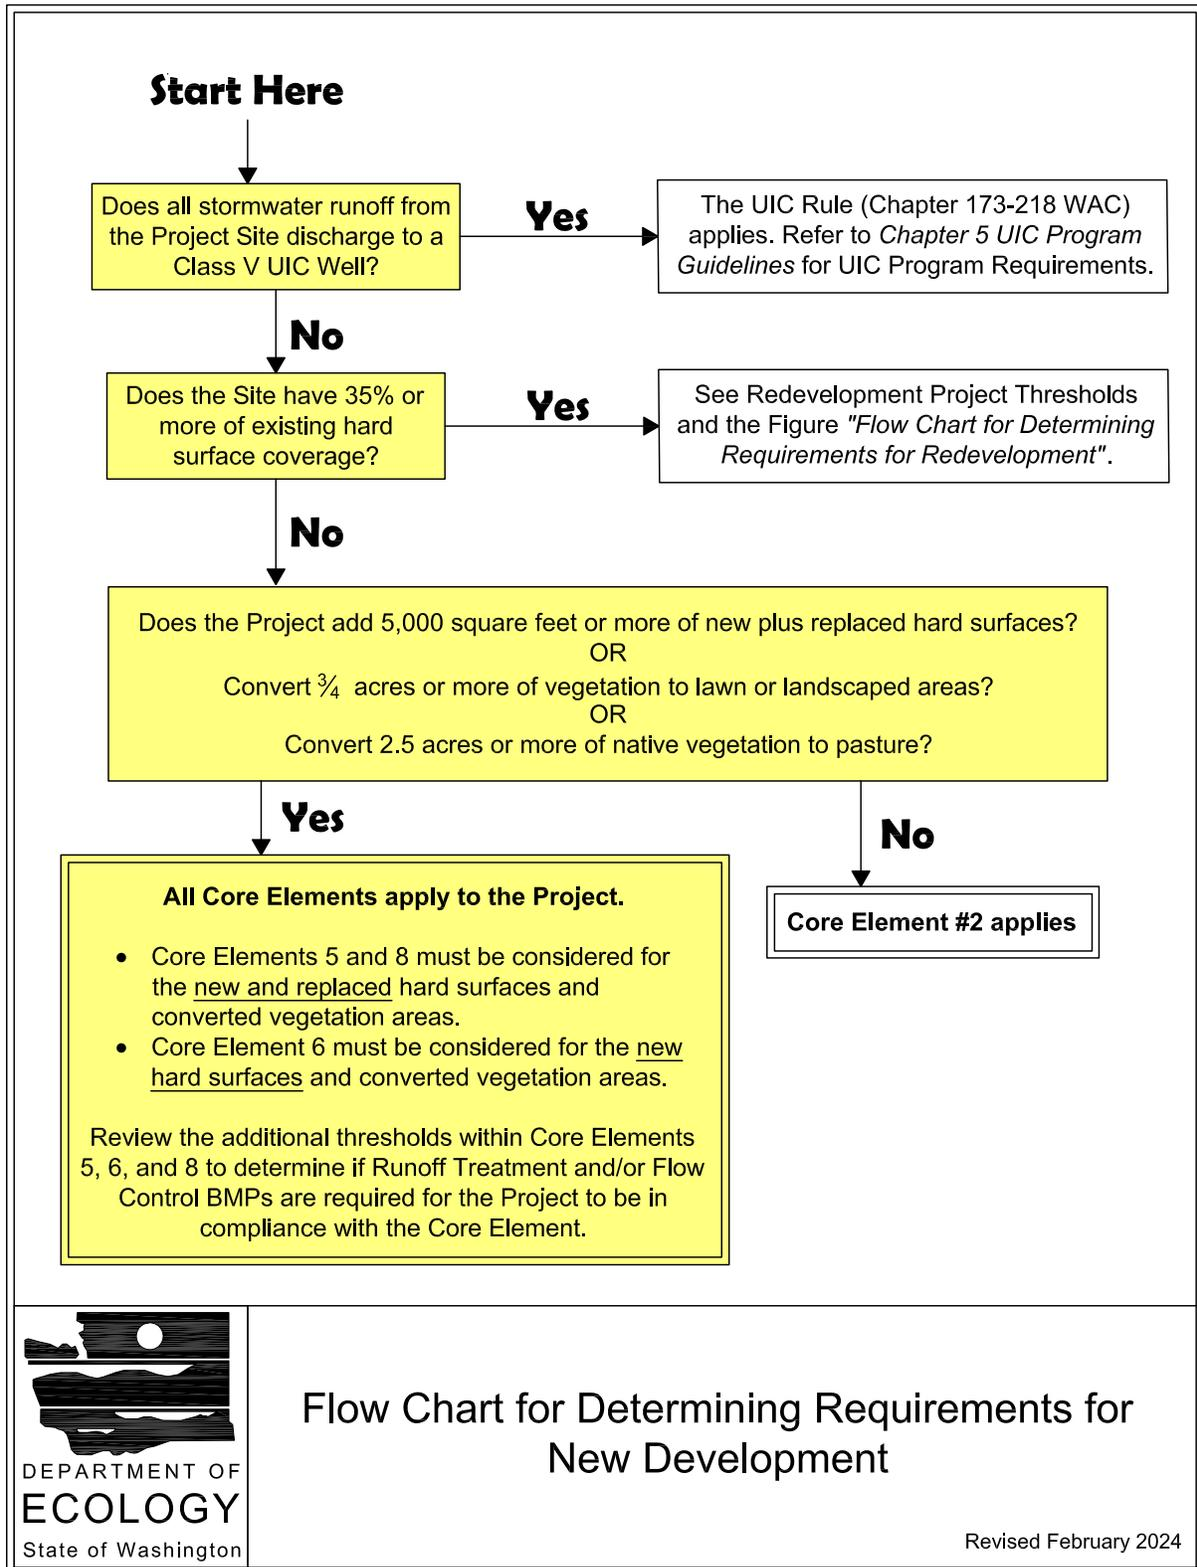

Flow Chart for Determining Requirements for
New Development

Revised February 2024

Figure 6.1: Runoff Treatment BMP Selection Flow Chart

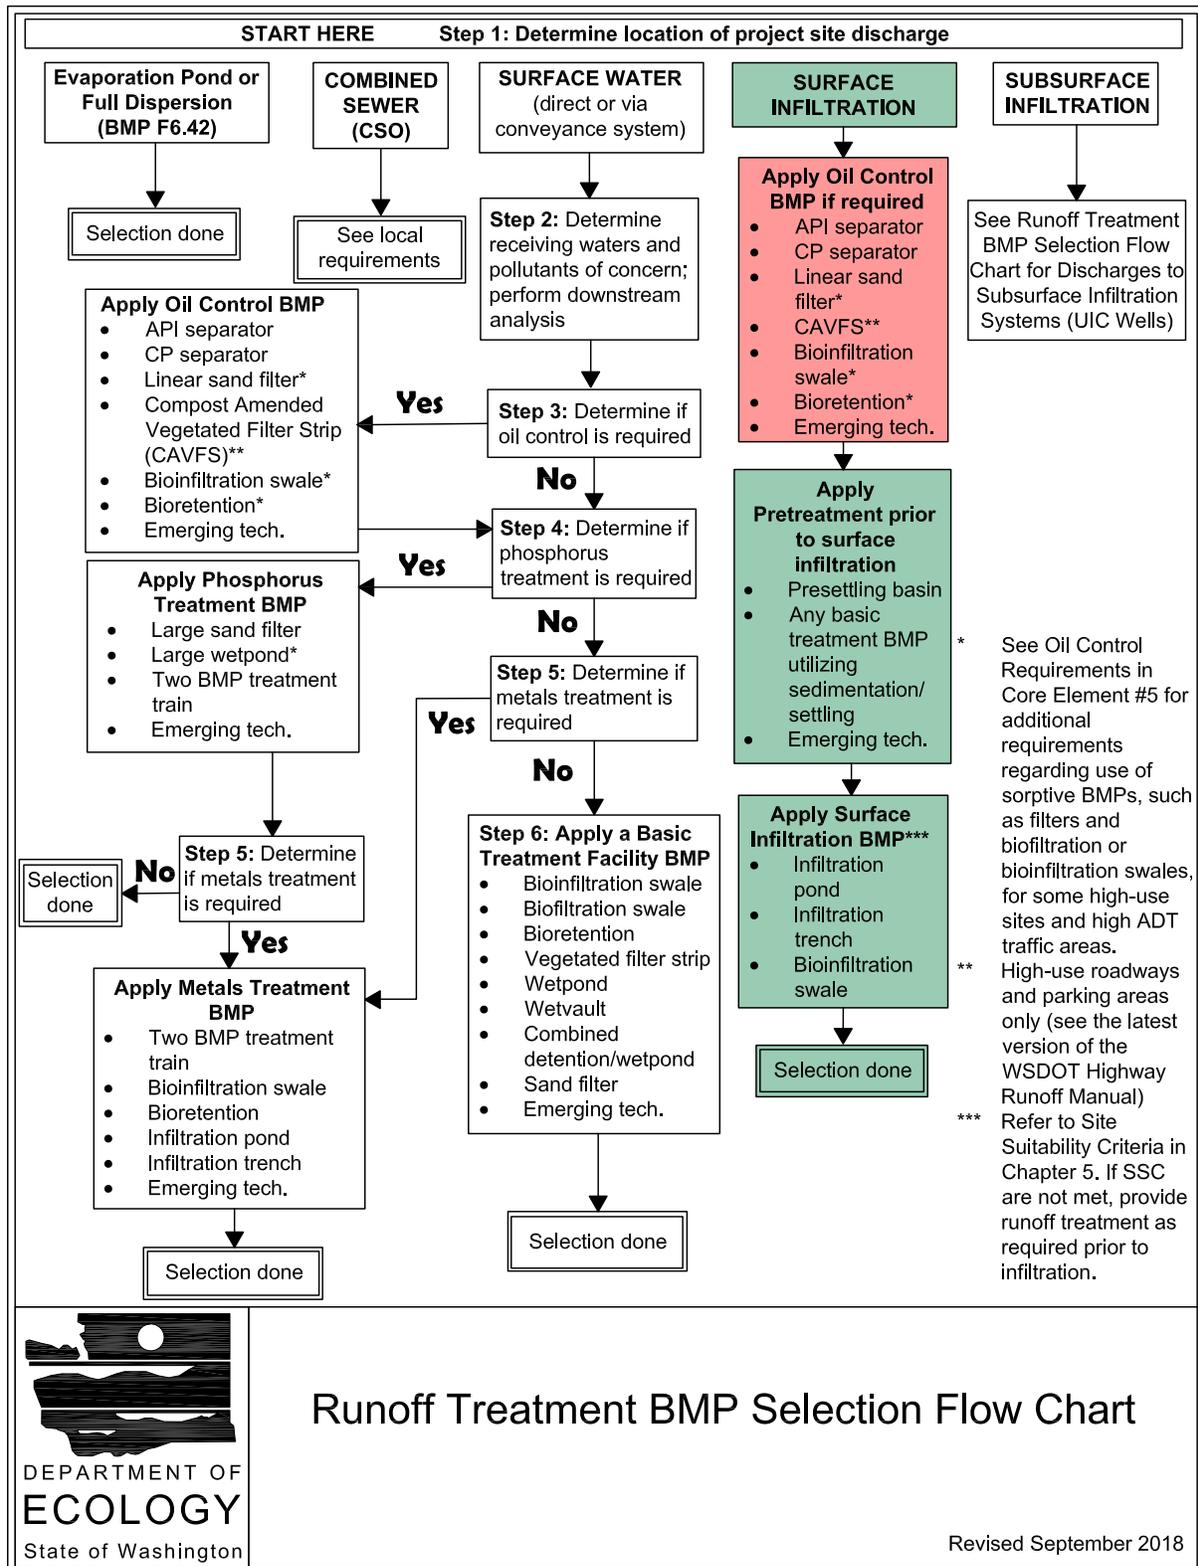


Runoff Treatment BMP Selection Flow Chart

Revised September 2018

3. Off-Site Analysis

Due to the high infiltration rate of onsite soils, this project proposes to infiltrate 100 percent of the 25-year, 24-hour storm event plus 24-hour snowmelt. Therefore, there is no anticipated discharge from the site. As such, there is no downstream path to analyze. The natural drainage pattern is concluded to be infiltrated through on-site soils, so analysis did not extend off-site. See the Existing Basin Map in the following pages for an overview of the existing site.

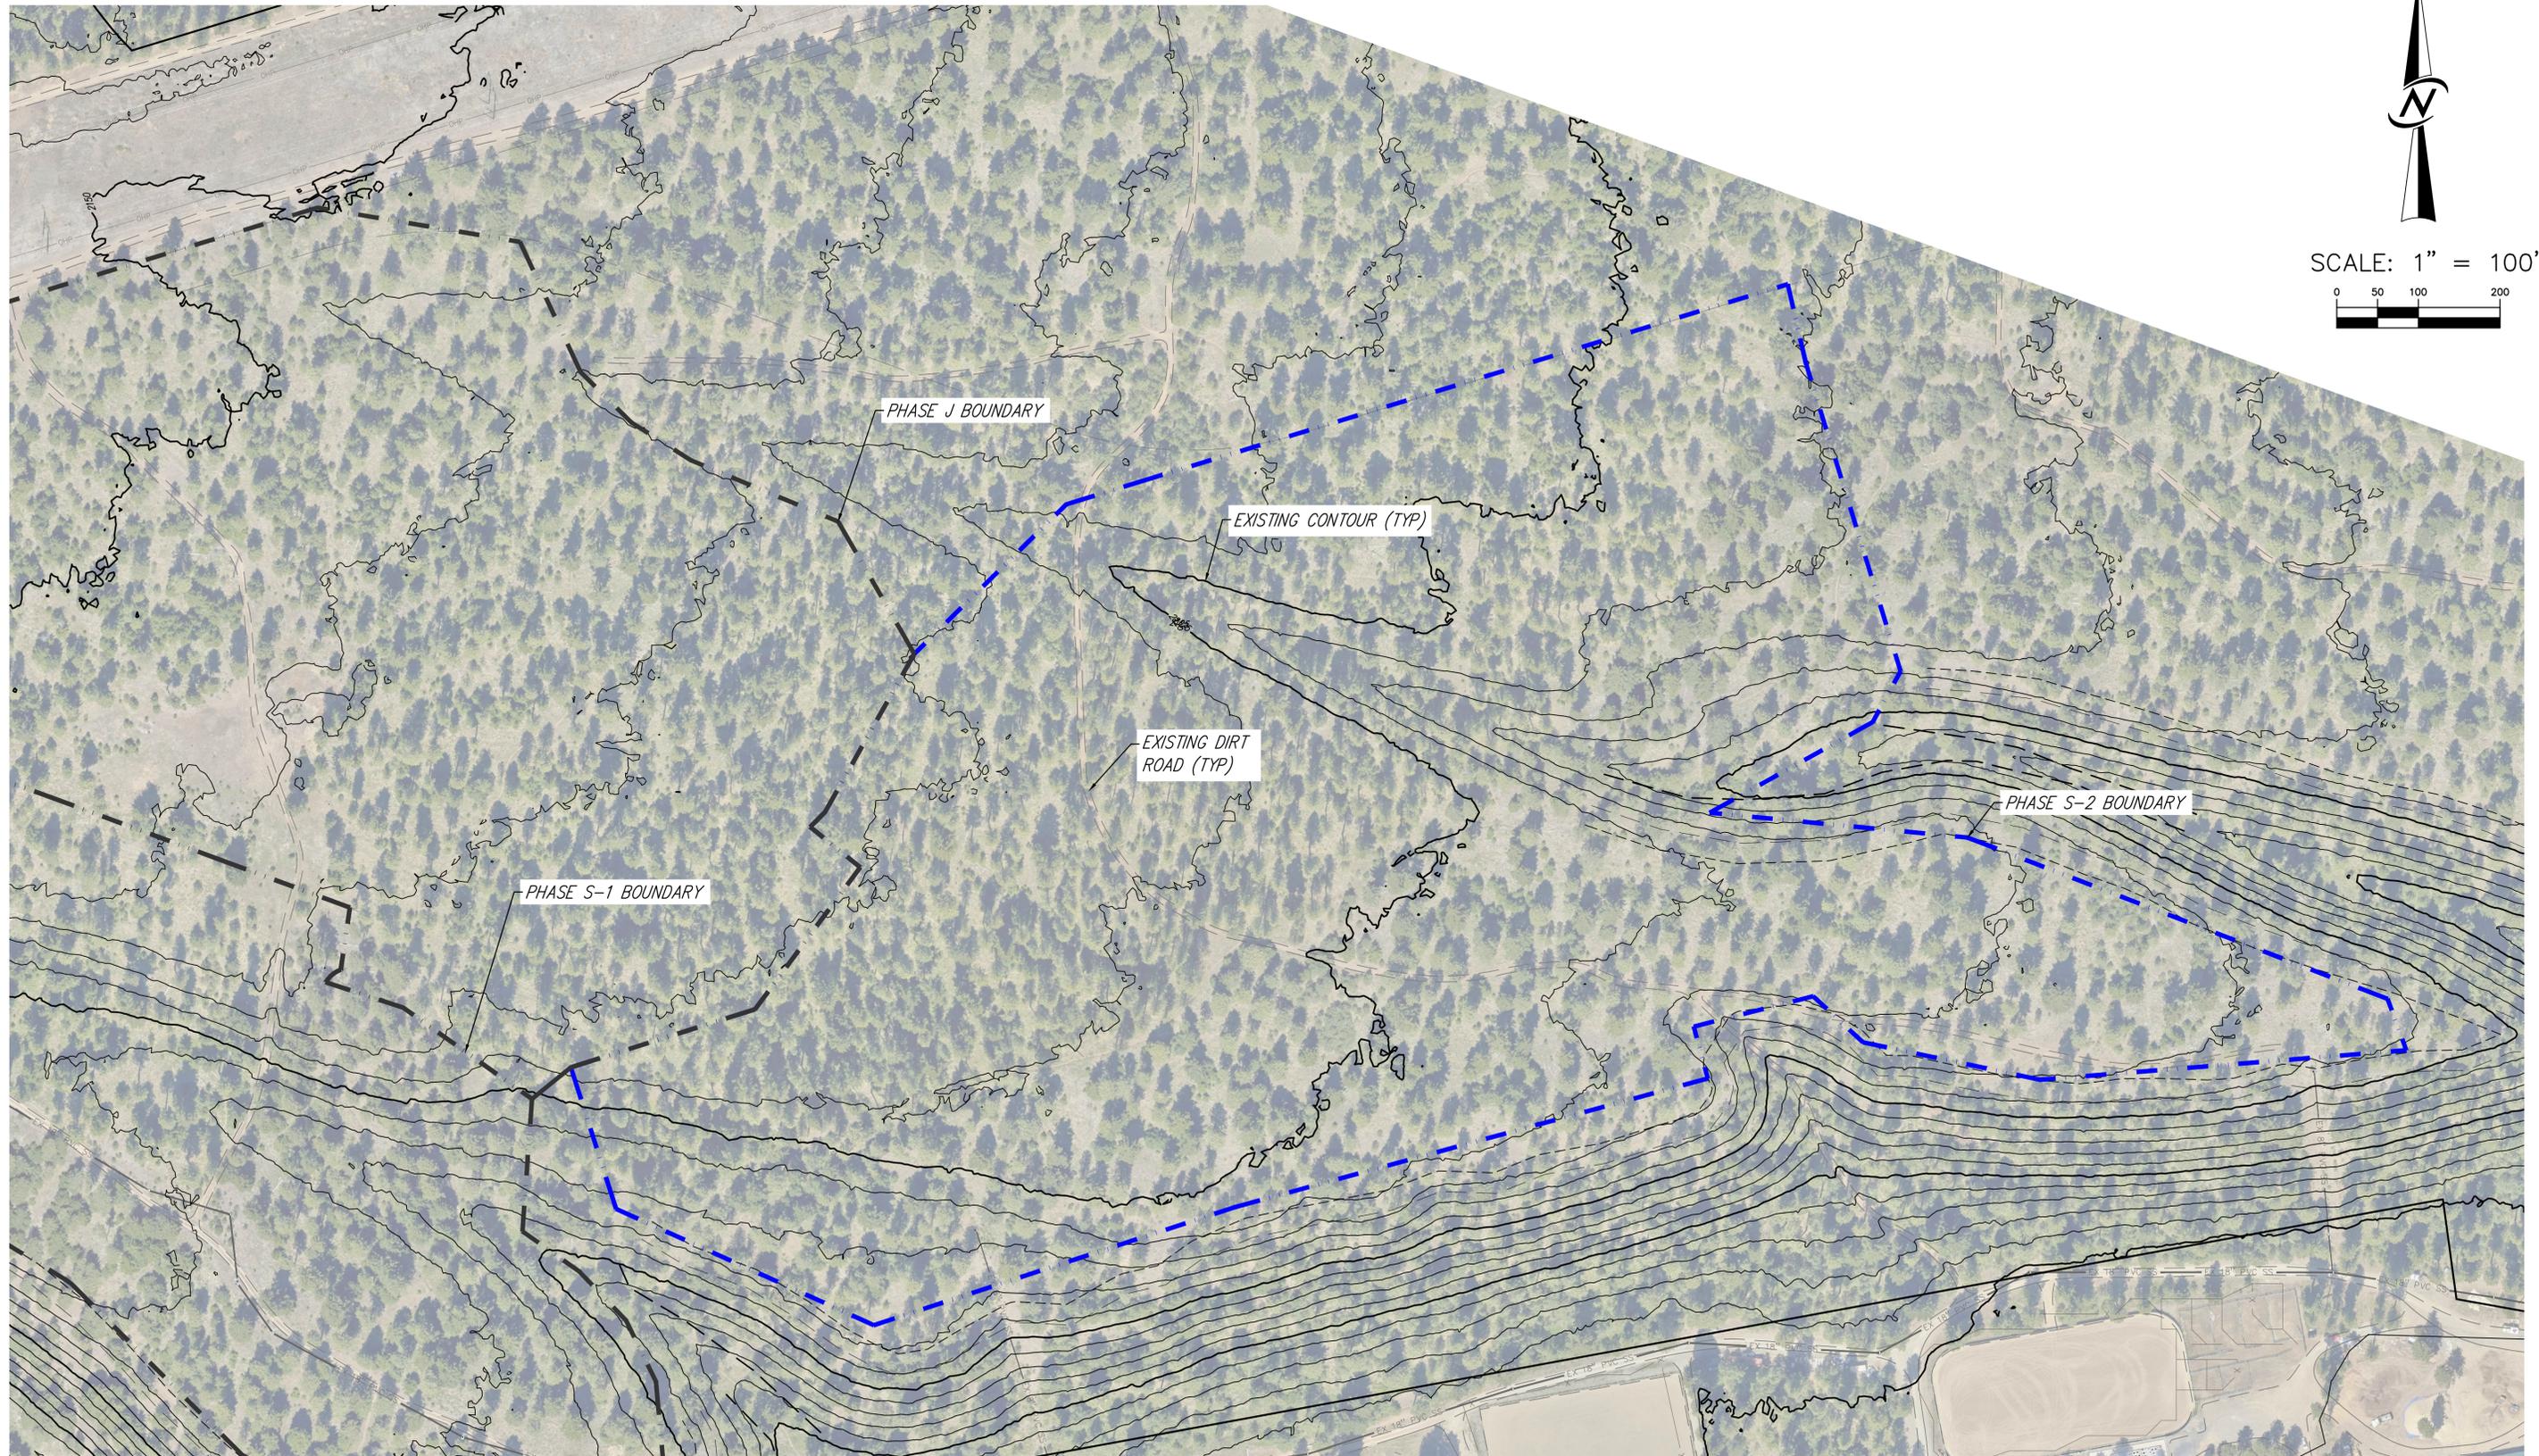

SCALE: 1" = 100'



BULLFROG - PHASE S-2

EXISTING CONDITIONS EXHIBIT

11/15/2024 11:12 AM J:\2024\2409\ENGINEERING\PRELIM\MAPS\EXHIBIT\11/15/24 SITE CONDITIONS EXHIBIT - EXISTING.DWG

4. Permanent Stormwater Control Analysis and Design

In order to mitigate the impacts of increased runoff from the developed site in comparison to the undeveloped site, flow control is required for this project. In order to meet this requirement, infiltration facilities are proposed to mitigate all impervious surfaces. Disturbed pervious surfaces are assumed to infiltrate all surface runoff, and are not included in the sizing for the infiltration facilities.

4.1 Stormwater Design Overview

This project proposed construction of three bioretention areas and two infiltration ponds. Additionally, the project will utilize a third infiltration pond, constructed under Phase S-1, to provide flow control for runoff from one of the bioretention basin areas. Each proposed bioretention area will provide runoff treatment from PGIS associated with portions of the spine road and internal roads for the project. Infiltration of all NPGIS associated with the individual lots is anticipated to consist of individual infiltration trenches which will be designed once proposed footprints have been determined for all lots.

4.2 Basin Information

As discussed in Section 4.1, the proposed infiltration ponds will be downstream of each of the three bioretention areas. The basins defined by each of these three bioretention areas are detailed in Table 4-1 below. The boundaries of these basins is also detailed in the Developed Conditions Exhibit, provided at the end of this section.

Table 4-1 Basin Areas

Subbasin	Area (sf)	Area (ac)
S1 East Basin	130885 sf	3.00 ac
S2 North Basin	146572 sf	3.36 ac
S2 East Basin	38795 sf	.89 ac

It should be noted that the S-1 East Basin has been designed under the Bullfrog – Phase S-1 project, and is tributary to the infiltration pond constructed under Phase S-1 of the development. This pond was sized to accommodate runoff from the S-1 East Basin area and bioretention facility to infiltrate 100 percent of the 25-year, 24-hour Type IA storm. Preliminary design information for the Phase S-1 Infiltration Pond is included in Appendix C of this report for reference.

4.3 Bioretention Design

The proposed bioretention areas have been designed for treatment based on the 6 month Water Quality 24-hour storm – 1.22 inches, as required under the Cle Elum 2024 Construction Standards.

4.3.2 Modeling Results

All bioretention sizing has been determined utilizing SBUH in HydroCAD, the reports of which are provided in Appendix A of this report. All three bioretention areas have been designed using an infiltration rate of 3.0 inches per hour across the vertical surface area only. Geometry of the proposed facilities varies, but all provide one foot of freeboard. Overflow for all bioretention facilities will be provided via an overflow structure, which will route all flows which do not infiltrate through the facility to the infiltration pond. See Section 4.4 for additional information regarding the design of the infiltration pond. Table 4-2 below provides the minimum required geometrical design of the bioretention facilities. All proposed bioretention areas will match the required design at minimum. Confirmation of this match will be provided at final design and again at as-builts.

Table 4-2 Bioretention Design Information

Basin	Bottom Length	Bottom Width	Base Area	Maximum Stage	Overflow Stage	Total Depth	Side Slope
S1 East	45.00'	70.00'	3,150 sf	1.00'	2.0'	7.8'	Vertical Rock Wall
S2 North	62.00'	50.00'	3,100 sf	1.00'	2.0'	3.0'	3H:1V
S2 East	20.00'	38.00'	760 sf	1.00'	2.0'	3.0'	3H:1V

4.4 Infiltration Pond Design

The proposed infiltration pond has been designed utilizing HydroCAD for the Type IA, 25-year, 24-hour storm event and 24-hour snow melt for the region. The precipitation depth was determined per the 2024 City of Cle Elum Design Standards. The estimated average daily snow depth was determined utilizing the methodology presented in the 2024 SWMMEW based on the data of Table 4.9 within the 2024 SWMMEW. This calculation is provided in Section 4.4.1 of this report for reference.

4.4.1 Snowmelt Adjustment Factor Calculation

According to the 2024 SWMMEW, the project site is located within Climate Region 1. No snowfall data for the project location is provided in the 2024 SWMMEW. As a result, the closest data available in Wenatchee was used to determine the average daily snow depth in Cle Elum.

The average annual precipitation for Wenatchee, per Figure 4.1 of the 2024 SWMMEW, is 10 inches. The average annual precipitation for Cle Elum from the same figure is 26 inches. The estimated average daily snow depth for Cle Elum was determined by multiplying the ratio of average annual precipitation between Cle Elum and Wenatchee against the average daily snow depth and all other adjustment factors.

$$S_{Cle\ Elum} = S_{Wenatchee} * \frac{P_{Cle\ Elum}}{P_{Wenatchee}}$$

Where: S_{City} is the average daily snow depth of that city in inches, and P_{City} is the average annual precipitation of that city in inches.

The calculated Average Daily Snow Depth of Cle Elum is 6.94 inches. A summary of the values used for this calculation is provided in Table 4-3 below.

Table 4-3 Average Daily Snow Depth Calculation

$P_{Wenatchee}$	10 in
$P_{Cle\ Elum}$	26 in
$P_{Cle\ Elum} / P_{Wenatchee}$	2.6
$S_{Wenatchee}$	2.67 in
$S_{Cle\ Elum}$	6.94 in

The equivalent snowmelt depth was determined utilizing a 20 percent snow moisture content, matching the relationships presented in Table 4.9 of the 2024 SWMMEW. As such, the Cle Elum Snowmelt 24-hour Adjustment utilized in sizing the infiltration pond was found to be 1.39 inches. See Table 4-4 for the referenced and calculated snowmelt factors.

Table 4-4 Snowmelt Adjustment Factors as adopted from the 2024 SWMMEW

Location	Average Daily Snow Depth (inches)	Water Equivalent (inches) 24-Hour Storm Precipitation Adjustment
Wenatchee	2.67	0.53
Cle Elum*	6.94	1.39

**Per calculations provided above*

4.4.2 Design Storm

In order to determine the design storm rainfall depth, the Type IA 25-year, 24-hour storm depth was combined with the Cle Elum Snowmelt 24-hour Adjustment. As discussed at the beginning of this section, the 25-year, 24-hour storm depth for the Type IA storm was determined from the 2024 City of Cle Elum Design Standards. This depth was found to be 3.48 inches. Upon combination with the Snowmelt 24-hour Adjustment, the design precipitation depth utilized for Flow Control modeling was determined to be 4.87 inches. See Table 4-6 below for a summary of this calculation.

Table 4-5 Design Storm Calculation

Snowmelt Adjustment	1.39 in
25-yr, 24-hr Depth	3.48 in
Design Storm Depth	4.87 in


4.4.3 Modeling Results

The proposed infiltration pond sizing has been determined utilizing SBUH in HydroCAD, the report of which is provided in Appendix B of this report. The models have been set up such that the overflows from each of the bioretention areas, as designed in Section 4.3 of this report, are routed to their proposed infiltration ponds. The proposed ponds have been designed assuming 3 to 1 side slopes and one foot of freeboard. Detailed information regarding the geometry of the proposed pond is provided in Table 4-6 below. As discussed in Section 4.2 of this report, the S-1 Pond has been designed and will be constructed under Phase S-1 of the Bullfrog development.

Table 4-6 Infiltration Pond Design Geometry

Basin	Bottom Length	Bottom Width	Base Area	Maximum Stage	Overflow Stage	Storage Volume
S1 Center	85.00'	85.00'	7,225 sf	6.00'	7.0'	68,298 cf
S2 North	106.00'	25.00'	2,650 SF	4.00'	5.0'	19,660 cf
S2 East	37.00'	20.00'	740 sf	3.00'	4.0'	4,848 cf

The proposed infiltration ponds will match the required designs at minimum. Confirmation of this match will be provided at final design and again at as-builts. The hydrograph produced by HydroCAD shows that all runoff routed to each of the infiltration ponds is infiltrated within 40 hours, less than the required 72 hours. As such, the proposed stormwater design will provide treatment and flow control via infiltration for all runoff from the project site through the 25-year storm. See the Hydrograph provided in the HydroCAD report in Appendix B for the ponds proposed to be constructed under this phase, and Appendix C for the HydroCAD report of the S-1 Pond, for reference.

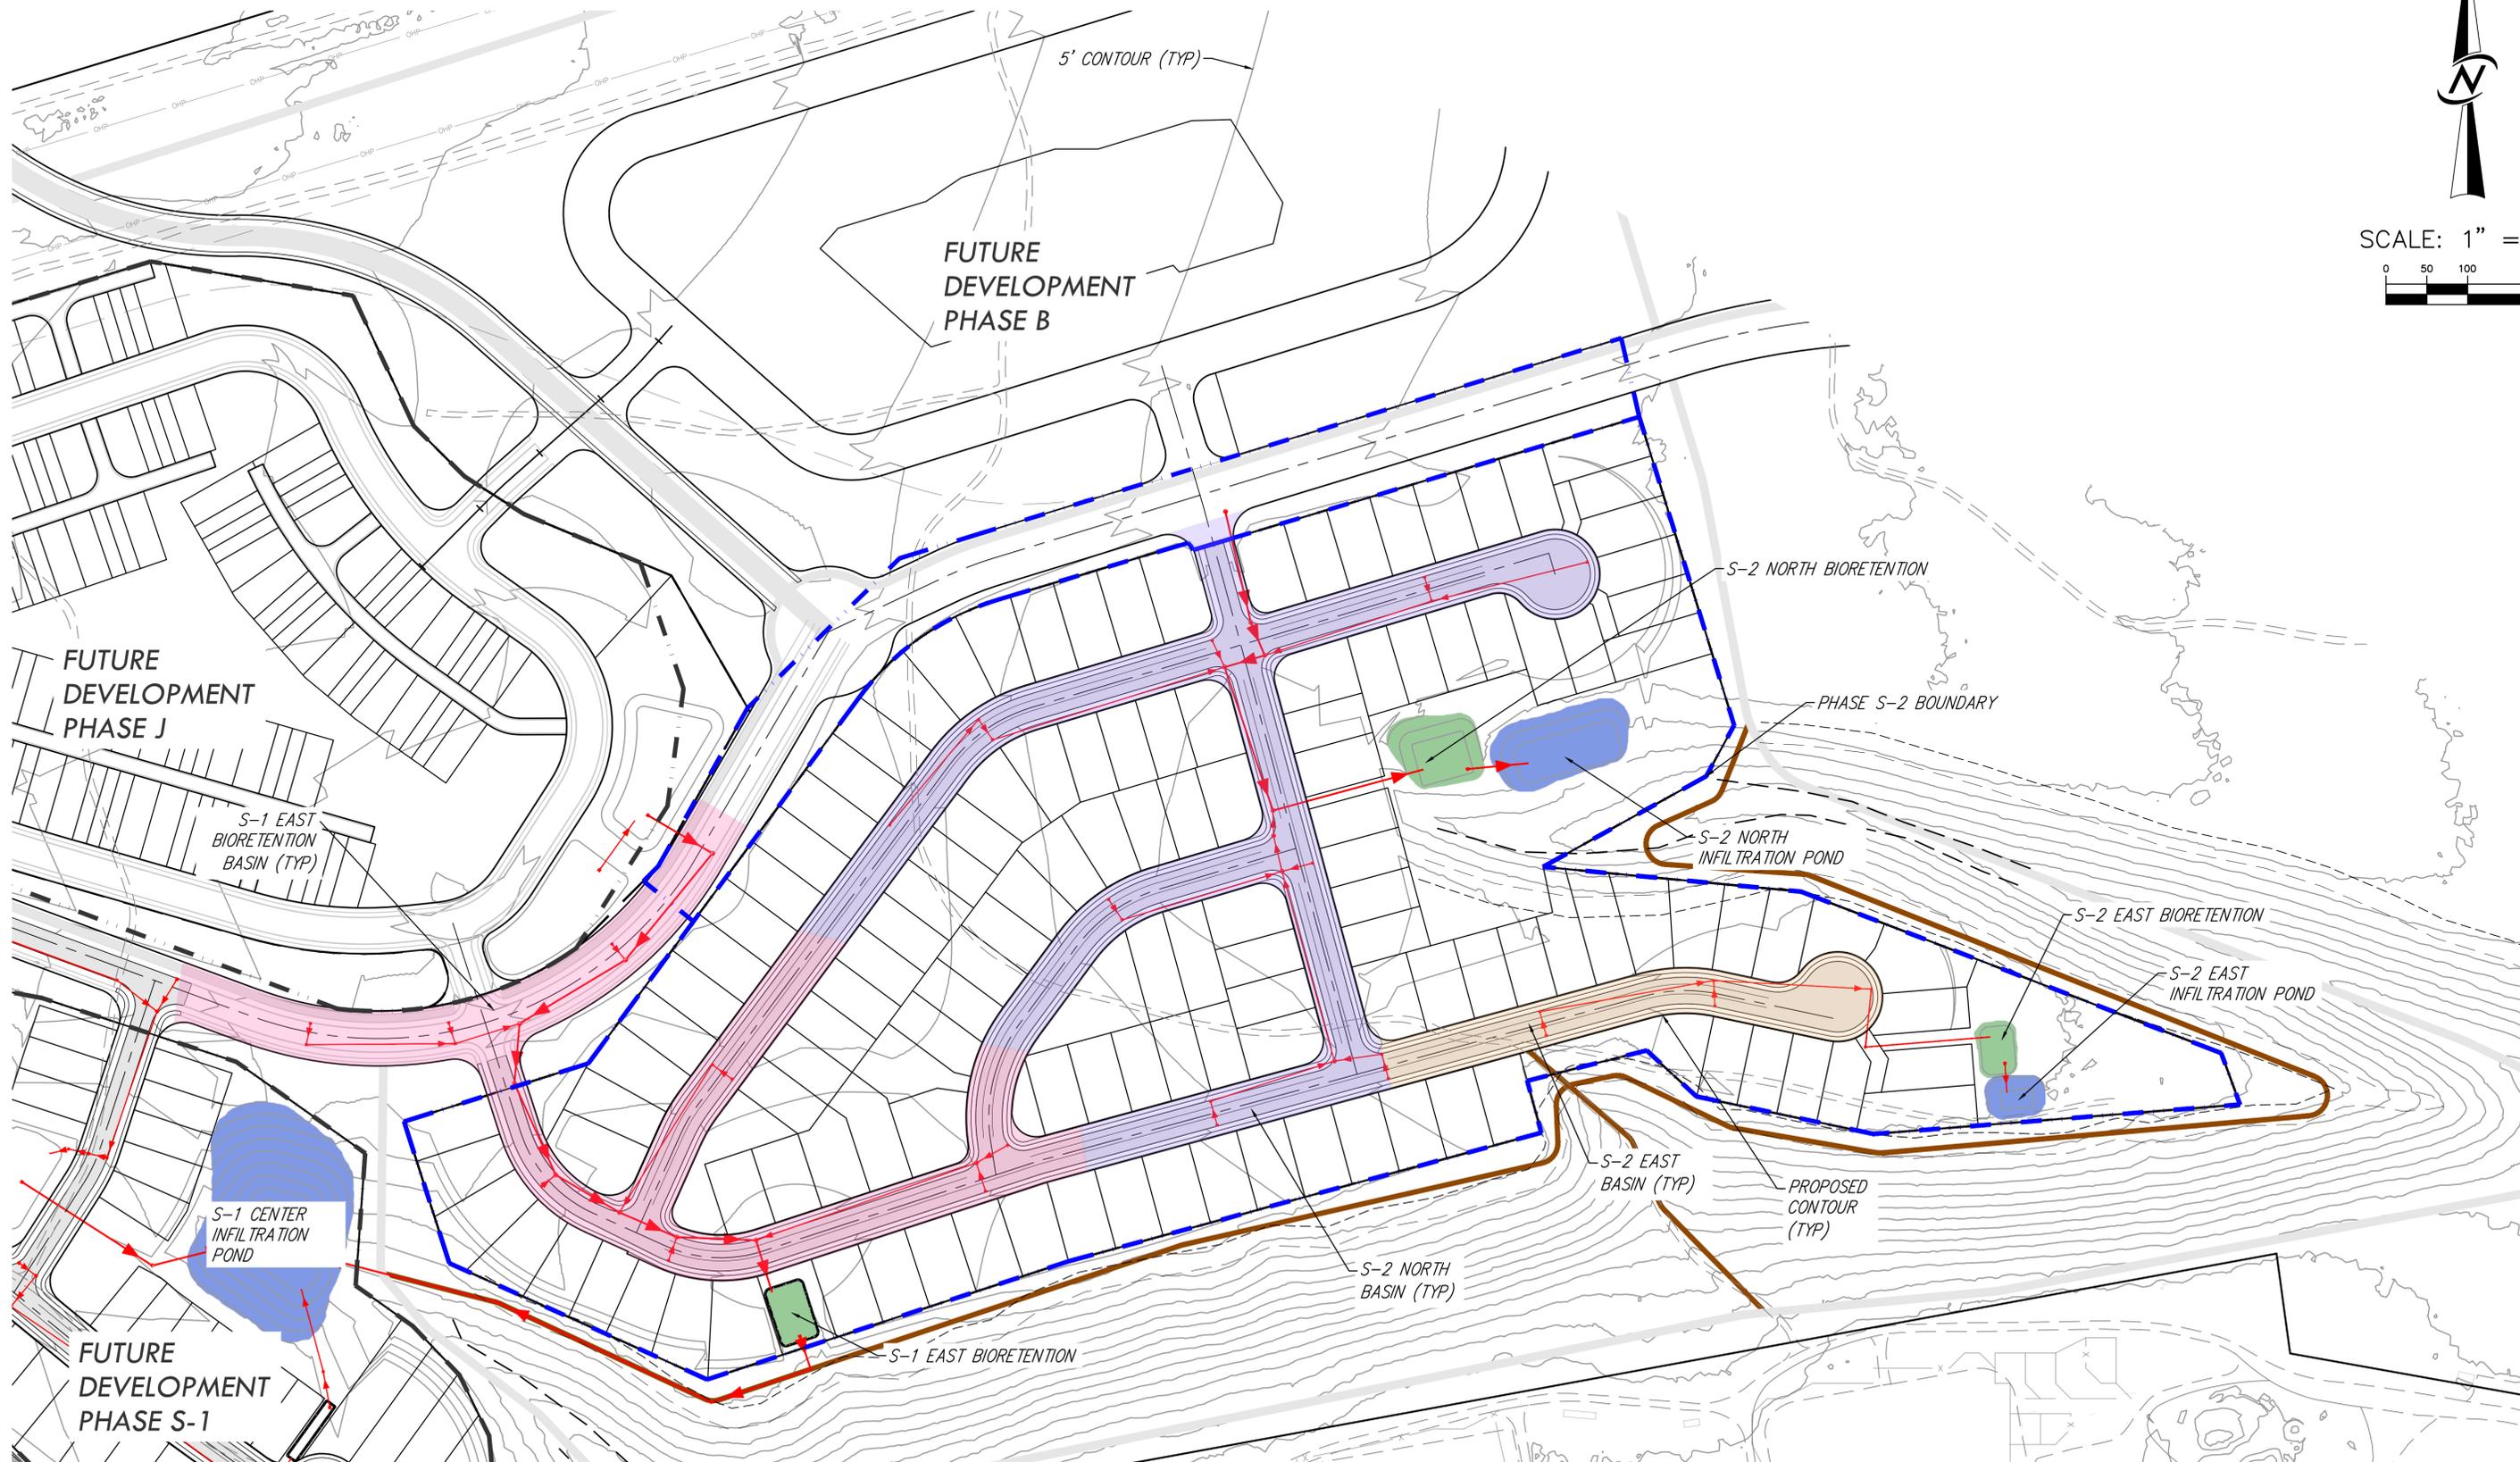

SCALE: 1" = 100'

BULLFROG - PHASE S-2

DEVELOPED CONDITIONS EXHIBIT

11/15/2024 11:16 AM J:\2024\24019\ENGINEERING\PRELIMINARY\EXHIBITS\PHASE S-2 SITE CONDITIONS EXHIBIT - DEVELOPED.DWG

5. Construction Stormwater Pollution Prevention Analysis


Erosion and sediment control for the project will be provided per the requirements of the 2024 SWMMEW. Additional information and analysis will be provided at final design.

6. Operations and Maintenance Manual


Operations and maintenance details for the applicable proposed stormwater facilities will be provided at final engineering design.

Appendix A



Bioretention Water Quality HydroCAD Reports

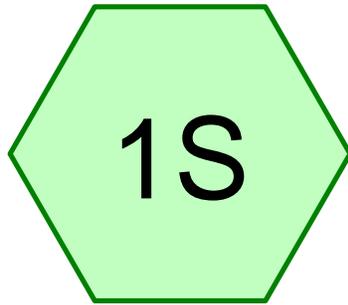

S-2 East Basin

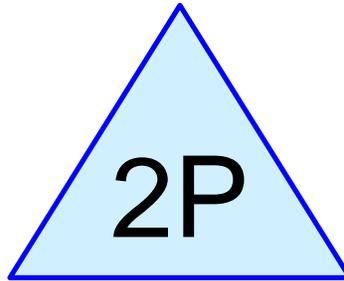

S-2 East Bioretention
Area



S-2 East Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-11-13

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.890	98	Roads (1S)
0.890	98	TOTAL AREA

S-2 East Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-11-13

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
0.890	Other	1S
0.890		TOTAL AREA

S-2 East Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-11-13

Page 4

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	0.890	0.890	Roads	1S
0.000	0.000	0.000	0.000	0.890	0.890	TOTAL AREA	

S-2 East Bioretention Area (WQ)

Type IA 24-hr Rainfall=1.61"

Prepared by Core Design

Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-72.00 hrs, dt=0.05 hrs, 1441 points
Runoff by SBUH method, Split Pervious/Imperv.
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: S-2 East Basin

Runoff Area=0.890 ac 100.00% Impervious Runoff Depth=1.39"
Tc=5.0 min CN=0/98 Runoff=0.32 cfs 0.103 af

Pond 2P: S-2 East Bioretention Area

Peak Elev=100.92' Storage=0.020 af Inflow=0.32 cfs 0.103 af
Discarded=0.08 cfs 0.103 af Primary=0.00 cfs 0.000 af Outflow=0.08 cfs 0.103 af

Total Runoff Area = 0.890 ac Runoff Volume = 0.103 af Average Runoff Depth = 1.39"
0.00% Pervious = 0.000 ac 100.00% Impervious = 0.890 ac

S-2 East Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Type IA 24-hr Rainfall=1.61"

Printed 2024-11-13

Page 6

Summary for Subcatchment 1S: S-2 East Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 0.32 cfs @ 7.91 hrs, Volume= 0.103 af, Depth= 1.39"
Routed to Pond 2P : S-2 East Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, $dt= 0.05$ hrs
Type IA 24-hr Rainfall=1.61"

Area (ac)	CN	Description
* 0.890	98	Roads
0.890	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 1S: S-2 East Basin

Hydrograph

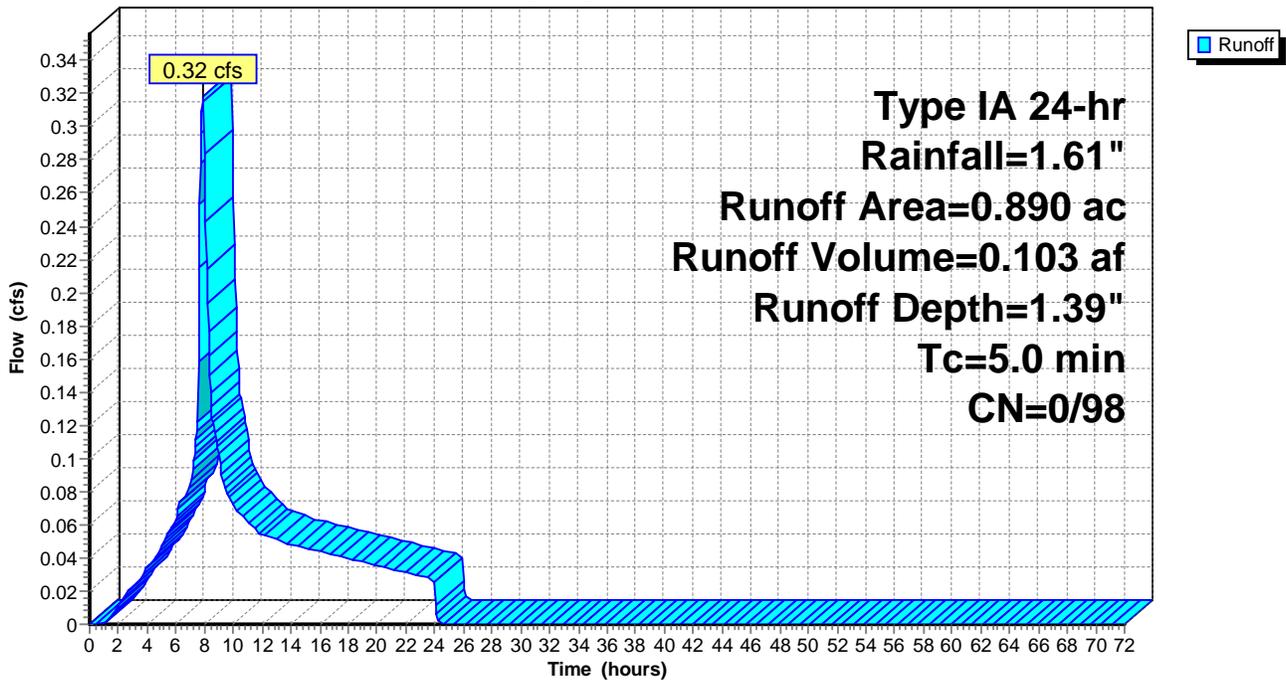

S-2 East Bioretention Area (WQ)

Type IA 24-hr Rainfall=1.61"

Prepared by Core Design

Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 7

Summary for Pond 2P: S-2 East Bioretention Area

Inflow Area = 0.890 ac, 100.00% Impervious, Inflow Depth = 1.39"
 Inflow = 0.32 cfs @ 7.91 hrs, Volume= 0.103 af
 Outflow = 0.08 cfs @ 9.72 hrs, Volume= 0.103 af, Atten= 76%, Lag= 109.0 min
 Discarded = 0.08 cfs @ 9.72 hrs, Volume= 0.103 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Peak Elev= 100.92' @ 9.72 hrs Surf.Area= 0.025 ac Storage= 0.020 af

Plug-Flow detention time= 97.2 min calculated for 0.103 af (100% of inflow)
 Center-of-Mass det. time= 97.1 min (787.5 - 690.3)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.096 af	20.00'W x 38.00'L x 3.00'H Prismatic Z=3.0


Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area


Discarded OutFlow Max=0.08 cfs @ 9.72 hrs HW=100.92' (Free Discharge)
 ↳ **2=Exfiltration** (Exfiltration Controls 0.08 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=100.00' (Free Discharge)
 ↳ **1=Orifice/Grate** (Controls 0.00 cfs)



Pond 2P: S-2 East Bioretention Area

Hydrograph


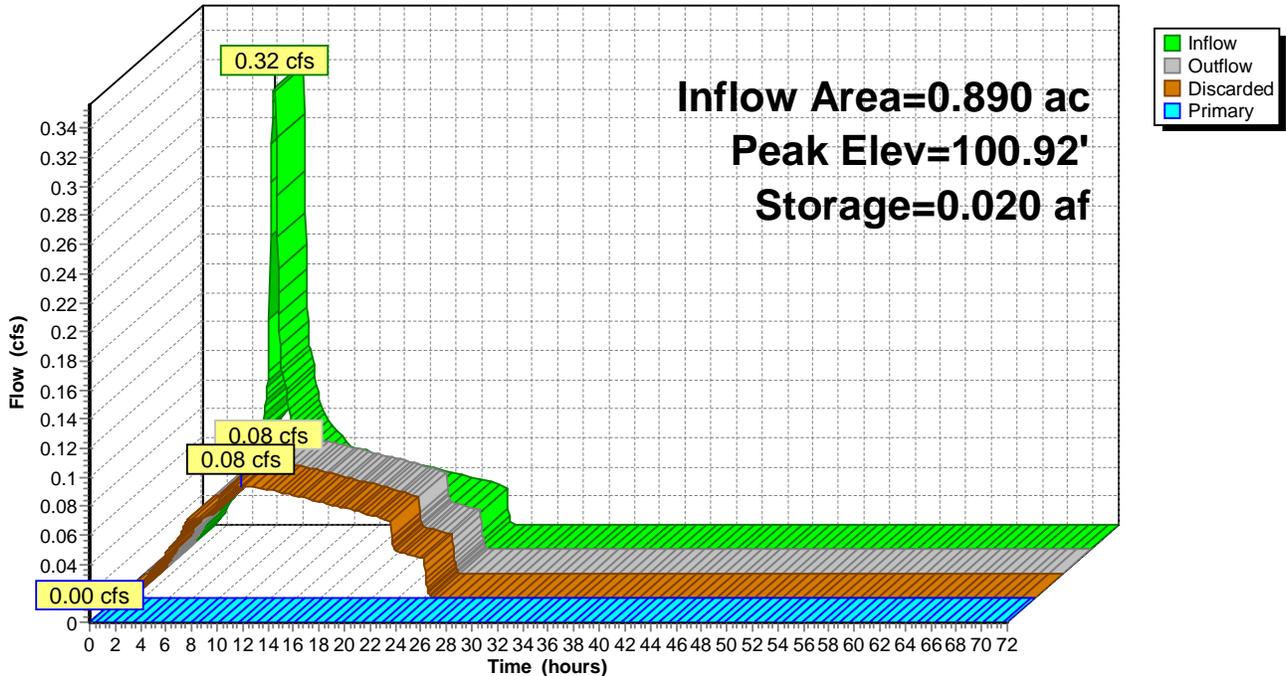


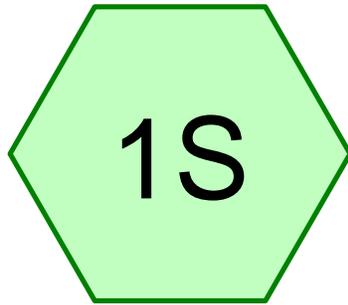

S-2 North Basin

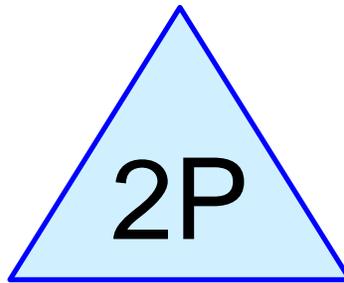

S-2 North Bioretention
Area



S-2 North Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-07-29

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
3.360	98	Roads (1S)
3.360	98	TOTAL AREA

S-2 North Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-07-29

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
3.360	Other	1S
3.360		TOTAL AREA

S-2 North Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-07-29

Page 4

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	3.360	3.360	Roads	1S
0.000	0.000	0.000	0.000	3.360	3.360	TOTAL AREA	

S-2 North Bioretention Area (WQ)

Type IA 24-hr Rainfall=1.61"

Prepared by Core Design

Printed 2024-07-29

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-72.00 hrs, dt=0.05 hrs, 1441 points
Runoff by SBUH method, Split Pervious/Imperv.
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: S-2 North Basin

Runoff Area=3.360 ac 100.00% Impervious Runoff Depth=1.39"
Tc=5.0 min CN=0/98 Runoff=1.20 cfs 0.389 af

Pond 2P: S-2 North Bioretention Area

Peak Elev=100.97' Storage=0.077 af Inflow=1.20 cfs 0.389 af
Discarded=0.26 cfs 0.389 af Primary=0.00 cfs 0.000 af Outflow=0.26 cfs 0.389 af

Total Runoff Area = 3.360 ac Runoff Volume = 0.389 af Average Runoff Depth = 1.39"
0.00% Pervious = 0.000 ac 100.00% Impervious = 3.360 ac

S-2 North Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Type IA 24-hr Rainfall=1.61"

Printed 2024-07-29

Page 6

Summary for Subcatchment 1S: S-2 North Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 1.20 cfs @ 7.91 hrs, Volume= 0.389 af, Depth= 1.39"
 Routed to Pond 2P : S-2 North Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Type IA 24-hr Rainfall=1.61"

Area (ac)	CN	Description
* 3.360	98	Roads
3.360	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 1S: S-2 North Basin

Hydrograph

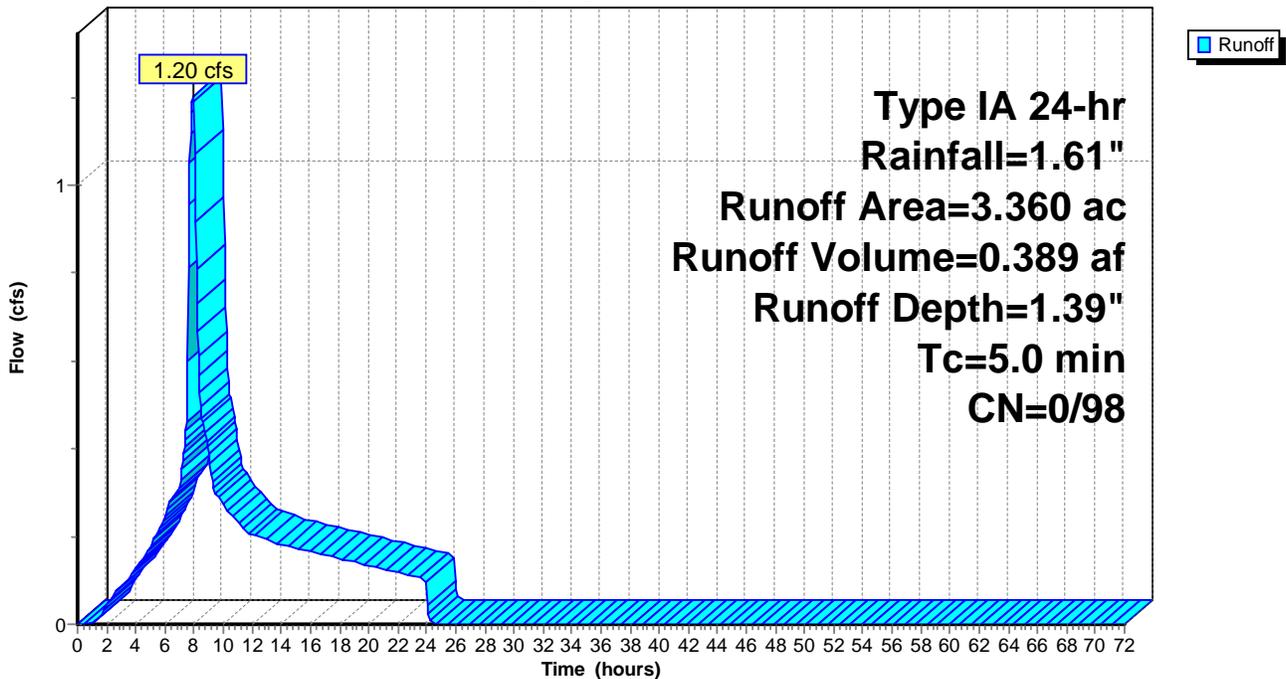

S-2 North Bioretention Area (WQ)

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Type IA 24-hr Rainfall=1.61"

Printed 2024-07-29

Page 7

Summary for Pond 2P: S-2 North Bioretention Area

Inflow Area = 3.360 ac, 100.00% Impervious, Inflow Depth = 1.39"
 Inflow = 1.20 cfs @ 7.91 hrs, Volume= 0.389 af
 Outflow = 0.26 cfs @ 10.16 hrs, Volume= 0.389 af, Atten= 78%, Lag= 134.9 min
 Discarded = 0.26 cfs @ 10.16 hrs, Volume= 0.389 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Peak Elev= 100.97' @ 10.16 hrs Surf.Area= 0.087 ac Storage= 0.077 af

Plug-Flow detention time= 113.0 min calculated for 0.389 af (100% of inflow)
 Center-of-Mass det. time= 113.0 min (803.3 - 690.3)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.290 af	62.00'W x 50.00'L x 3.00'H Prismatic Z=3.0


Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.26 cfs @ 10.16 hrs HW=100.97' (Free Discharge)
 ↳ **2=Exfiltration** (Exfiltration Controls 0.26 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=100.00' (Free Discharge)
 ↳ **1=Orifice/Grate** (Controls 0.00 cfs)


Pond 2P: S-2 North Bioretention Area

Hydrograph

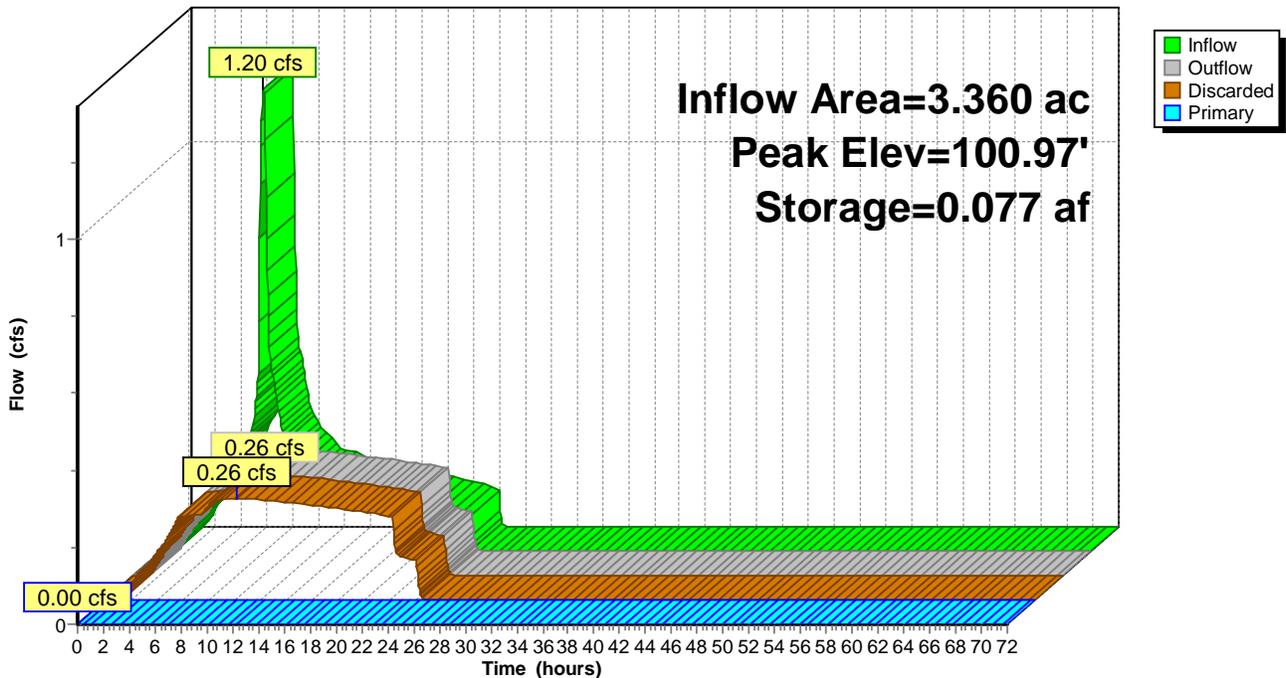


Appendix B


Overall HydroCAD Reports





S-2 East Basin



S-2 East Bioretention
Area



S-2 East Infiltration
Pond



Routing Diagram for S-2 East Bioretention Area & Infiltration Pond Connected

Prepared by Core Design, Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

S-2 East Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-11-13

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.890	98	Roads (1S)
0.890	98	TOTAL AREA

S-2 East Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-11-13

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
0.890	Other	1S
0.890		TOTAL AREA

S-2 East Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-11-13

Page 4

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	0.890	0.890	Roads	1S
0.000	0.000	0.000	0.000	0.890	0.890	TOTAL AREA	

S-2 East Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-72.00 hrs, dt=0.05 hrs, 1441 points
Runoff by SBUH method, Split Pervious/Imperv.
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: S-2 East Basin

Runoff Area=0.890 ac 100.00% Impervious Runoff Depth=5.65"
Tc=5.0 min CN=0/98 Runoff=1.24 cfs 0.419 af

Pond 2P: S-2 East Bioretention Area

Peak Elev=101.43' Storage=0.034 af Inflow=1.24 cfs 0.419 af
Discarded=0.09 cfs 0.178 af Primary=1.13 cfs 0.241 af Outflow=1.22 cfs 0.419 af

Pond 3P: S-2 East Infiltration Pond

Peak Elev=2.97' Storage=0.092 af Inflow=1.13 cfs 0.241 af
Discarded=0.19 cfs 0.241 af Primary=0.00 cfs 0.000 af Outflow=0.19 cfs 0.241 af

Total Runoff Area = 0.890 ac Runoff Volume = 0.419 af Average Runoff Depth = 5.65"
0.00% Pervious = 0.000 ac 100.00% Impervious = 0.890 ac

S-2 East Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment 1S: S-2 East Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 1.24 cfs @ 7.89 hrs, Volume= 0.419 af, Depth= 5.65"
 Routed to Pond 2P : S-2 East Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, $dt= 0.05$ hrs
 Type IA 24-hr Rainfall=5.89"

Area (ac)	CN	Description
* 0.890	98	Roads
0.890	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 1S: S-2 East Basin

Hydrograph

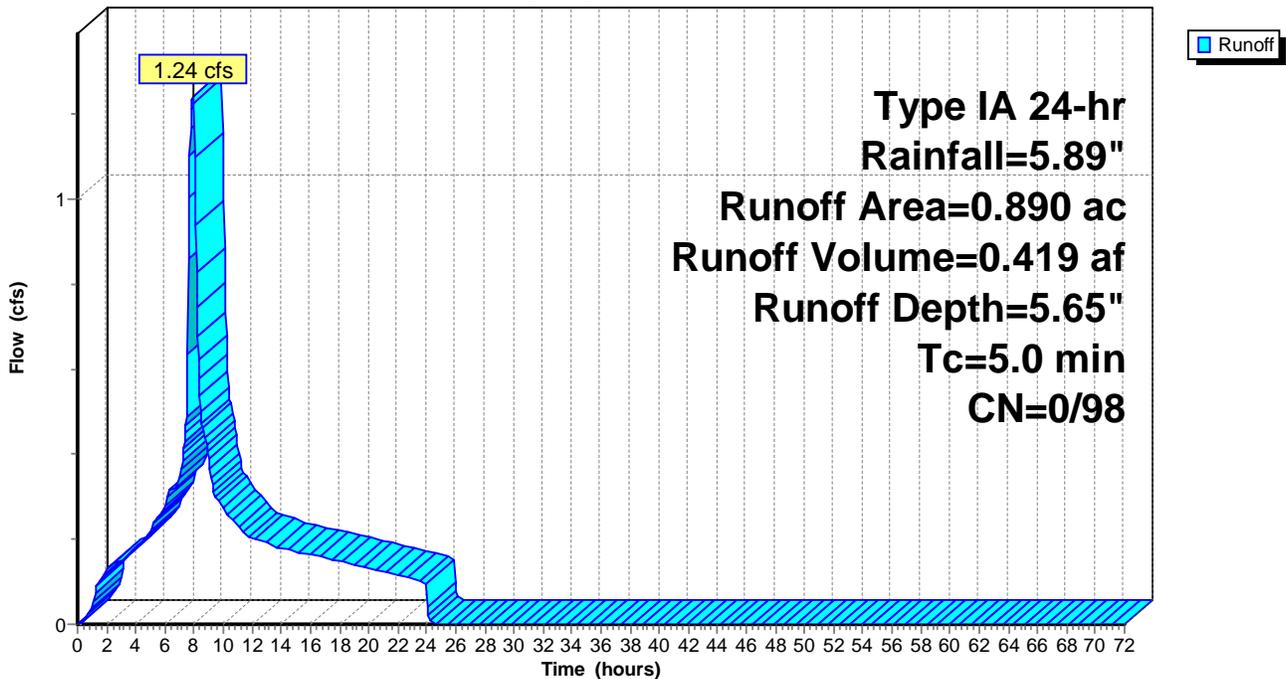

S-2 East Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 7

Summary for Pond 2P: S-2 East Bioretention Area

Inflow Area = 0.890 ac, 100.00% Impervious, Inflow Depth = 5.65"
Inflow = 1.24 cfs @ 7.89 hrs, Volume= 0.419 af
Outflow = 1.22 cfs @ 7.98 hrs, Volume= 0.419 af, Atten= 2%, Lag= 4.9 min
Discarded = 0.09 cfs @ 7.98 hrs, Volume= 0.178 af
Primary = 1.13 cfs @ 7.98 hrs, Volume= 0.241 af
Routed to Pond 3P : S-2 East Infiltration Pond

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
Peak Elev= 101.43' @ 7.98 hrs Surf.Area= 0.031 ac Storage= 0.034 af

Plug-Flow detention time= 82.7 min calculated for 0.419 af (100% of inflow)
Center-of-Mass det. time= 82.8 min (735.6 - 652.8)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.096 af	20.00'W x 38.00'L x 3.00'H Prismaoid Z=3.0

Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.09 cfs @ 7.98 hrs HW=101.43' (Free Discharge)
↑**2=Exfiltration** (Exfiltration Controls 0.09 cfs)

Primary OutFlow Max=1.12 cfs @ 7.98 hrs HW=101.43' (Free Discharge)
↑**1=Orifice/Grate** (Orifice Controls 1.12 cfs @ 2.24 fps)

S-2 East Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC


Type IA 24-hr Rainfall=5.89"

Printed 2024-11-13

Page 8

Pond 2P: S-2 East Bioretention Area

Hydrograph

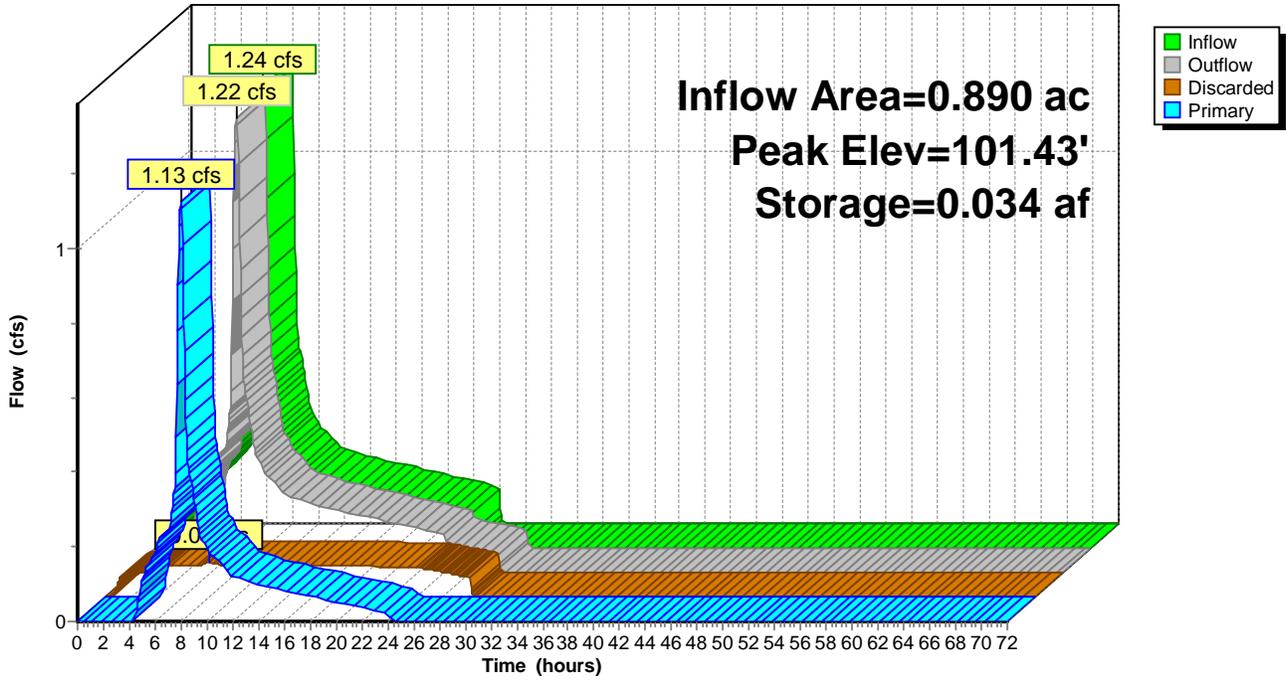

S-2 East Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-11-13

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 9

Summary for Pond 3P: S-2 East Infiltration Pond

Inflow Area = 0.890 ac, 100.00% Impervious, Inflow Depth = 3.25"
 Inflow = 1.13 cfs @ 7.98 hrs, Volume= 0.241 af
 Outflow = 0.19 cfs @ 10.12 hrs, Volume= 0.241 af, Atten= 83%, Lag= 128.4 min
 Discarded = 0.19 cfs @ 10.12 hrs, Volume= 0.241 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Peak Elev= 2.97' @ 10.12 hrs Surf.Area= 0.048 ac Storage= 0.092 af

Plug-Flow detention time= 252.2 min calculated for 0.241 af (100% of inflow)
 Center-of-Mass det. time= 252.1 min (888.5 - 636.4)

Volume	Invert	Avail.Storage	Storage Description
#1	0.00'	0.148 af	37.00'W x 20.00'L x 4.00'H Prismatic Z=3.0


Device	Routing	Invert	Outlet Devices
#1	Primary	3.00'	24.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	0.00'	4.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.19 cfs @ 10.12 hrs HW=2.97' (Free Discharge)
 ↳ **2=Exfiltration** (Exfiltration Controls 0.19 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)
 ↳ **1=Orifice/Grate** (Controls 0.00 cfs)


Pond 3P: S-2 East Infiltration Pond

Hydrograph

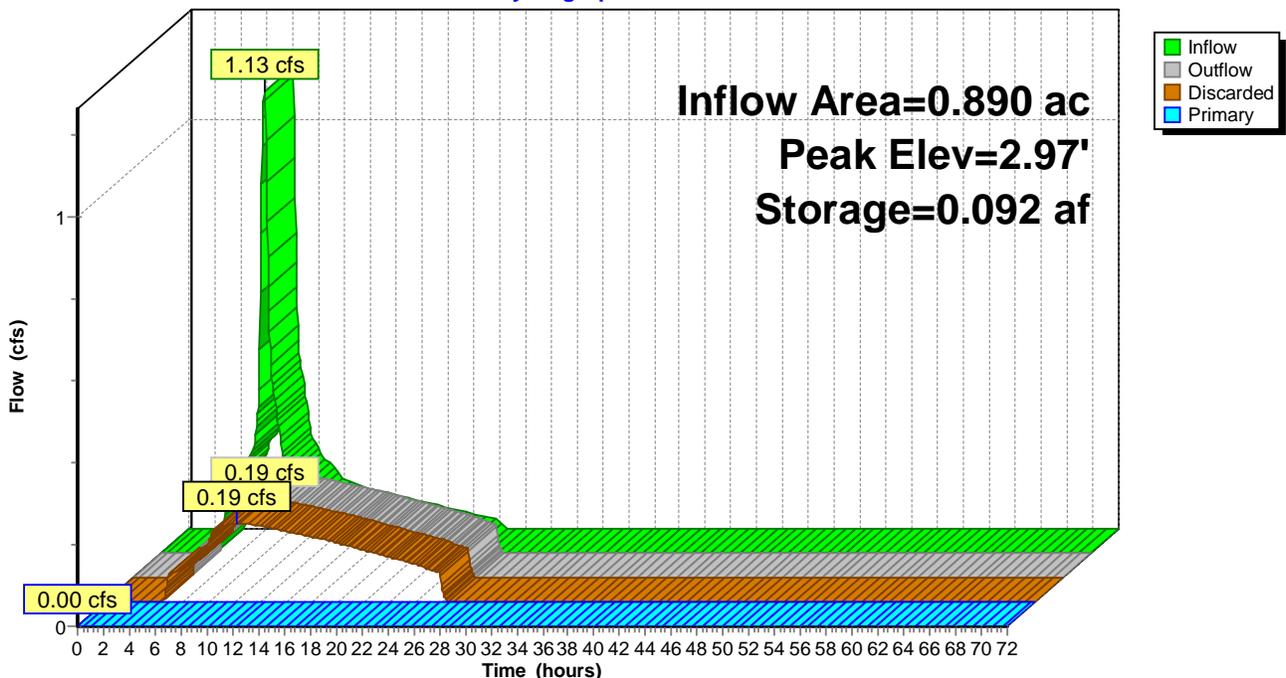






S-2 North Basin



S-2 North Bioretention
Area



S-2 North Infiltration
Pond



Routing Diagram for S-2 North Bioretention Area & Infiltration Pond Connected

Prepared by Core Design, Printed 2024-07-29

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

S-2 North Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-07-29

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
3.360	98	Roads (1S)
3.360	98	TOTAL AREA

S-2 North Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-07-29

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
3.360	Other	1S
3.360		TOTAL AREA

S-2 North Bioretention Area & Infiltration Pond Connected

Prepared by Core Design

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 2024-07-29

Page 4

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	3.360	3.360	Roads	1S
0.000	0.000	0.000	0.000	3.360	3.360	TOTAL AREA	

S-2 North Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-07-29

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-72.00 hrs, dt=0.05 hrs, 1441 points
Runoff by SBUH method, Split Pervious/Imperv.
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: S-2 North Basin

Runoff Area=3.360 ac 100.00% Impervious Runoff Depth=5.65"
Tc=5.0 min CN=0/98 Runoff=4.69 cfs 1.583 af

Pond 2P: S-2 North Bioretention Area

Peak Elev=101.86' Storage=0.161 af Inflow=4.69 cfs 1.583 af
Discarded=0.31 cfs 0.614 af Primary=4.06 cfs 0.968 af Outflow=4.37 cfs 1.583 af

Pond 3P: S-2 North Infiltration Pond

Peak Elev=3.99' Storage=0.404 af Inflow=4.06 cfs 0.968 af
Discarded=0.59 cfs 0.968 af Primary=0.00 cfs 0.000 af Outflow=0.59 cfs 0.968 af

Total Runoff Area = 3.360 ac Runoff Volume = 1.583 af Average Runoff Depth = 5.65"
0.00% Pervious = 0.000 ac 100.00% Impervious = 3.360 ac

S-2 North Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-07-29

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment 1S: S-2 North Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 4.69 cfs @ 7.89 hrs, Volume= 1.583 af, Depth= 5.65"
 Routed to Pond 2P : S-2 North Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, $dt= 0.05$ hrs
 Type IA 24-hr Rainfall=5.89"

Area (ac)	CN	Description
* 3.360	98	Roads
3.360	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 1S: S-2 North Basin

Hydrograph

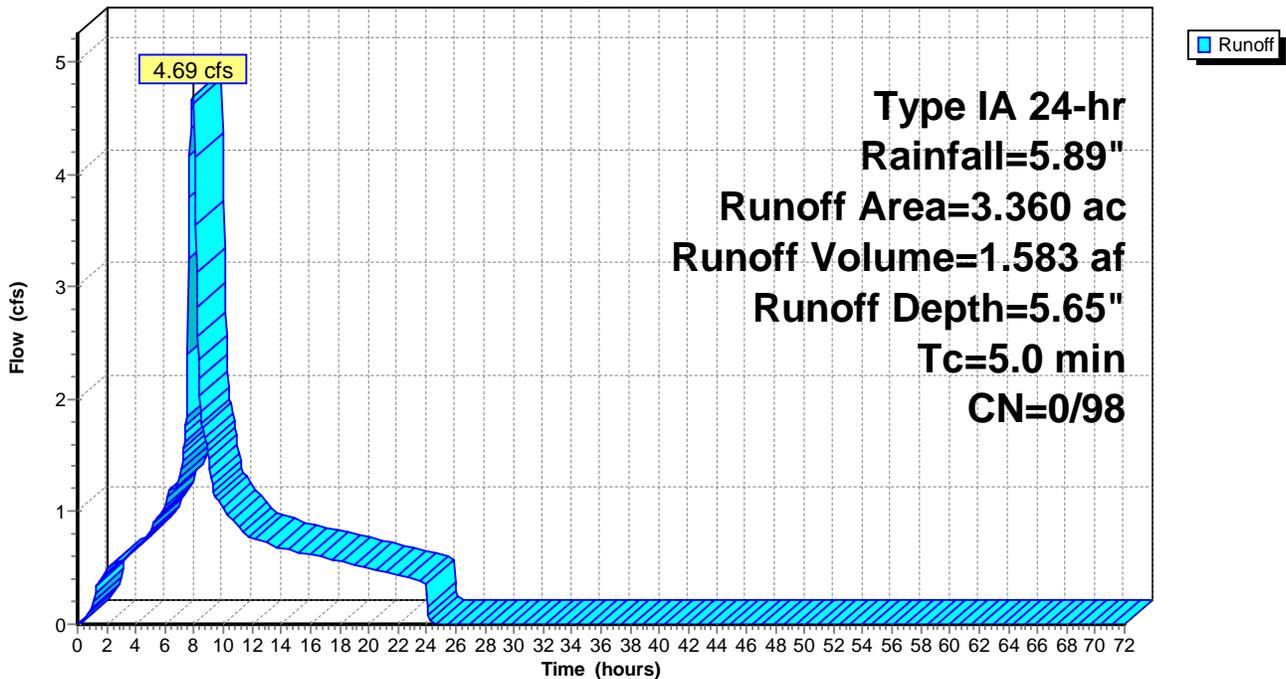

S-2 North Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-07-29

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 7

Summary for Pond 2P: S-2 North Bioretention Area

Inflow Area = 3.360 ac, 100.00% Impervious, Inflow Depth = 5.65"
Inflow = 4.69 cfs @ 7.89 hrs, Volume= 1.583 af
Outflow = 4.37 cfs @ 8.02 hrs, Volume= 1.583 af, Atten= 7%, Lag= 7.8 min
Discarded = 0.31 cfs @ 8.02 hrs, Volume= 0.614 af
Primary = 4.06 cfs @ 8.02 hrs, Volume= 0.968 af
Routed to Pond 3P : S-2 North Infiltration Pond

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
Peak Elev= 101.86' @ 8.02 hrs Surf.Area= 0.103 ac Storage= 0.161 af

Plug-Flow detention time= 90.2 min calculated for 1.581 af (100% of inflow)
Center-of-Mass det. time= 90.3 min (743.1 - 652.8)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.290 af	62.00'W x 50.00'L x 3.00'H Prismatic Z=3.0


Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.31 cfs @ 8.02 hrs HW=101.86' (Free Discharge)
↑**2=Exfiltration** (Exfiltration Controls 0.31 cfs)

Primary OutFlow Max=4.04 cfs @ 8.02 hrs HW=101.86' (Free Discharge)
↑**1=Orifice/Grate** (Orifice Controls 4.04 cfs @ 3.15 fps)

Pond 2P: S-2 North Bioretention Area

Hydrograph

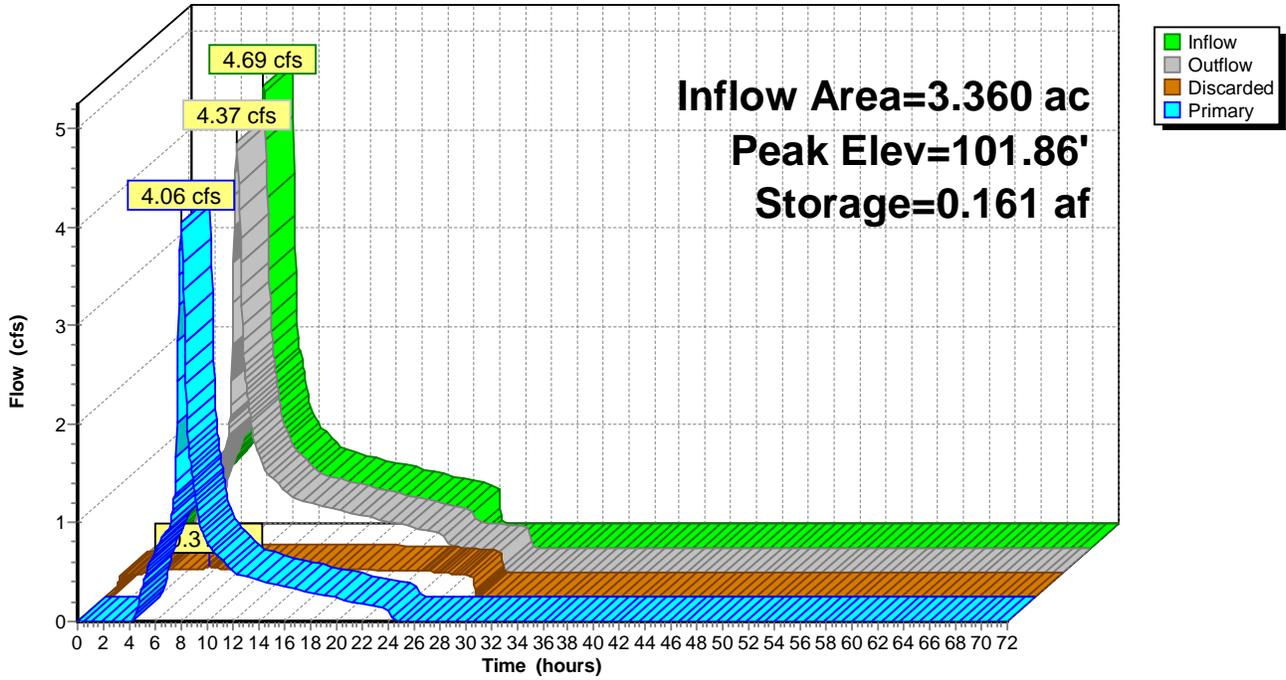

S-2 North Bioretention Area & Infiltration Pond Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 2024-07-29

HydroCAD® 10.20-5a s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 9

Summary for Pond 3P: S-2 North Infiltration Pond

Inflow Area = 3.360 ac, 100.00% Impervious, Inflow Depth = 3.46"
 Inflow = 4.06 cfs @ 8.02 hrs, Volume= 0.968 af
 Outflow = 0.59 cfs @ 11.43 hrs, Volume= 0.968 af, Atten= 85%, Lag= 204.2 min
 Discarded = 0.59 cfs @ 11.43 hrs, Volume= 0.968 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Peak Elev= 3.99' @ 11.43 hrs Surf.Area= 0.146 ac Storage= 0.404 af

Plug-Flow detention time= 366.5 min calculated for 0.968 af (100% of inflow)
 Center-of-Mass det. time= 366.6 min (1,023.6 - 657.0)

Volume	Invert	Avail.Storage	Storage Description
#1	0.00'	0.564 af	106.00'W x 25.00'L x 5.00'H Prismatic Z=3.0


Device	Routing	Invert	Outlet Devices
#1	Primary	4.00'	24.0" Vert. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	0.00'	4.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.59 cfs @ 11.43 hrs HW=3.99' (Free Discharge)
 ↳ **2=Exfiltration** (Exfiltration Controls 0.59 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)
 ↳ **1=Orifice/Grate** (Controls 0.00 cfs)




Pond 3P: S-2 North Infiltration Pond

Hydrograph

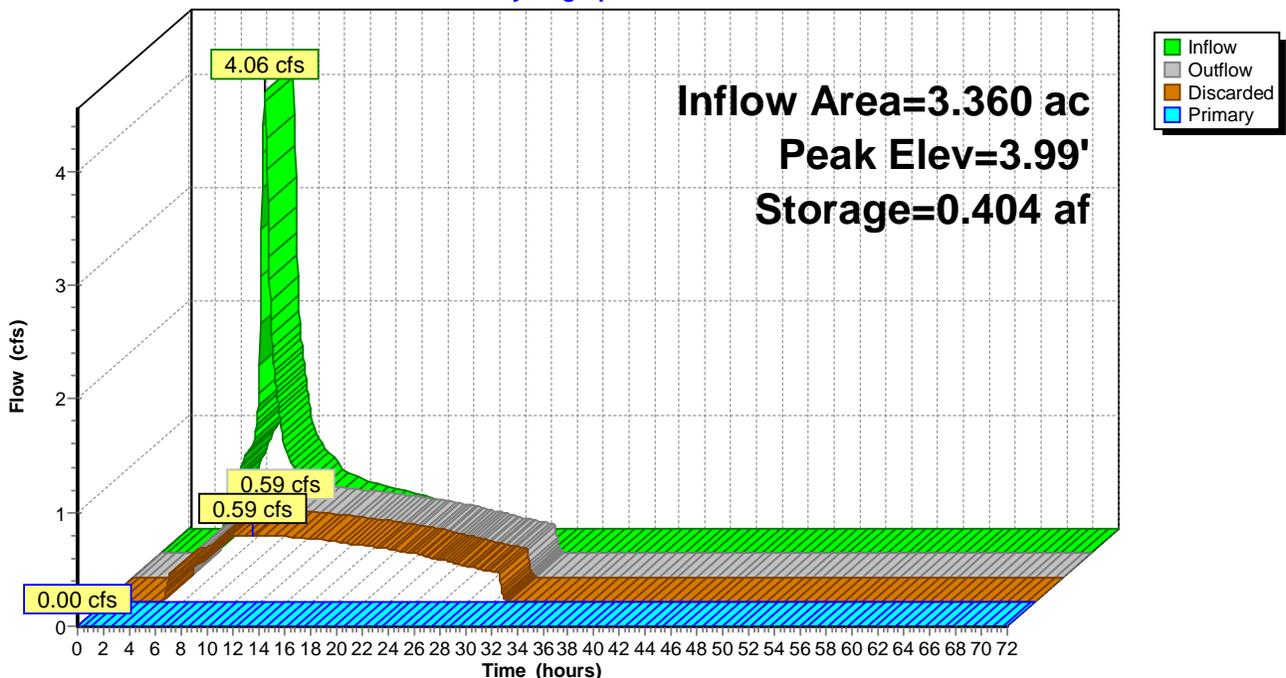

Appendix C

S-1 Center Pond HydroCAD Report

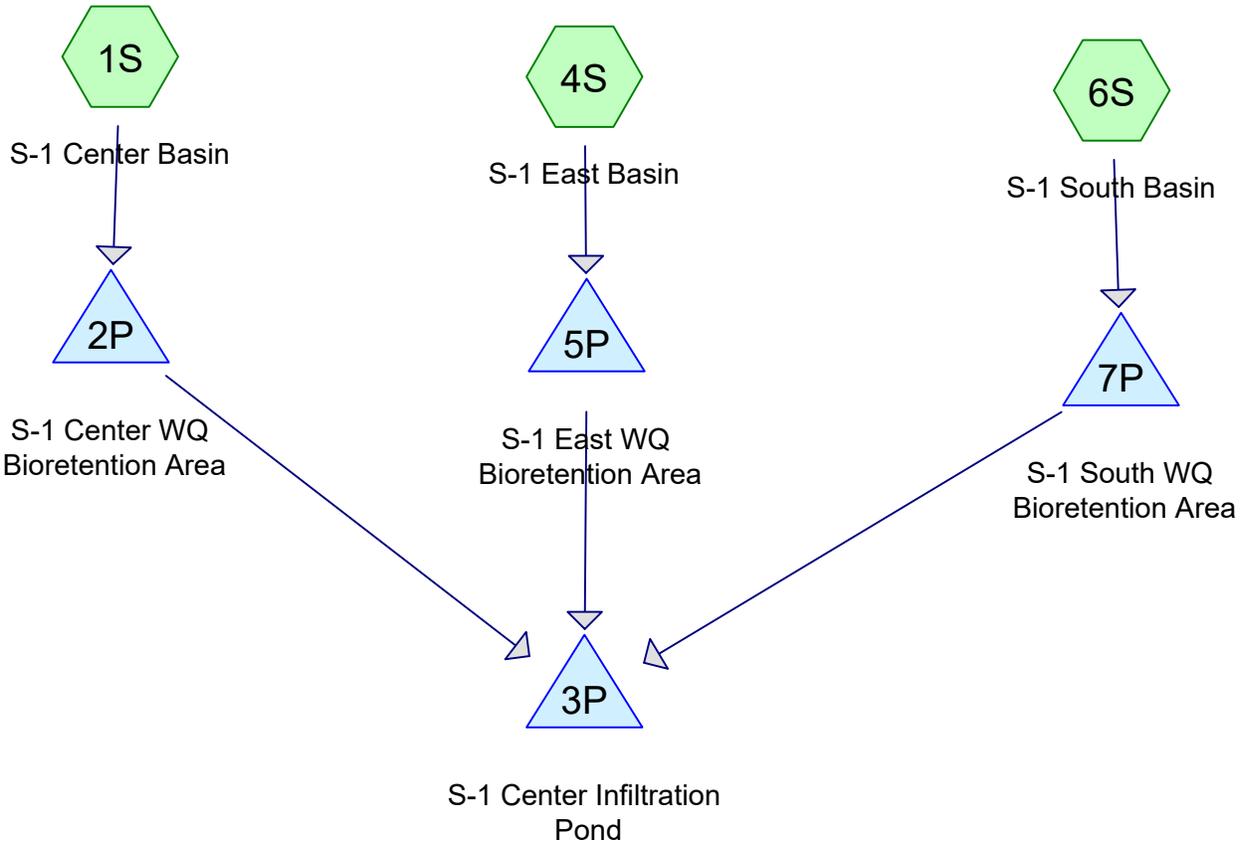

Routing Diagram for S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design, Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 11/13/2024

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
9.860	98	Roads (1S, 4S, 6S)
9.860	98	TOTAL AREA

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 11/13/2024

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
0.000	HSG C	
0.000	HSG D	
9.860	Other	1S, 4S, 6S
9.860		TOTAL AREA

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Printed 11/13/2024

Page 4

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.000	0.000	9.860	9.860	Roads	1S, 4S, 6S
0.000	0.000	0.000	0.000	9.860	9.860	TOTAL AREA	

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-72.00 hrs, dt=0.05 hrs, 1441 points

Runoff by SBUH method, Split Pervious/Imperv.

Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: S-1 Center Basin Runoff Area=5.810 ac 100.00% Impervious Runoff Depth=5.65"
Tc=5.0 min CN=0/98 Runoff=8.11 cfs 2.737 af

Subcatchment4S: S-1 East Basin Runoff Area=3.000 ac 100.00% Impervious Runoff Depth=5.65"
Tc=5.0 min CN=0/98 Runoff=4.19 cfs 1.413 af

Subcatchment6S: S-1 South Basin Runoff Area=1.050 ac 100.00% Impervious Runoff Depth=5.65"
Tc=5.0 min CN=0/98 Runoff=1.47 cfs 0.495 af

Pond 2P: S-1 Center WQ Bioretention Area Peak Elev=101.51' Storage=0.212 af Inflow=8.11 cfs 2.737 af
Discarded=0.48 cfs 0.995 af Primary=7.45 cfs 1.742 af Outflow=7.92 cfs 2.737 af

Pond 3P: S-1 Center Infiltration Pond Peak Elev=5.87' Storage=1.432 af Inflow=12.74 cfs 2.987 af
Discarded=1.34 cfs 2.987 af Primary=0.00 cfs 0.000 af Outflow=1.34 cfs 2.987 af

Pond 5P: S-1 East WQ Bioretention Area Peak Elev=101.33' Storage=0.096 af Inflow=4.19 cfs 1.413 af
Discarded=0.22 cfs 0.494 af Primary=3.94 cfs 0.919 af Outflow=4.16 cfs 1.413 af

Pond 7P: S-1 South WQ Bioretention Area Peak Elev=101.17' Storage=0.029 af Inflow=1.47 cfs 0.495 af
Discarded=0.07 cfs 0.169 af Primary=1.39 cfs 0.326 af Outflow=1.46 cfs 0.495 af

Total Runoff Area = 9.860 ac Runoff Volume = 4.644 af Average Runoff Depth = 5.65"
0.00% Pervious = 0.000 ac 100.00% Impervious = 9.860 ac

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment 1S: S-1 Center Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 8.11 cfs @ 7.89 hrs, Volume= 2.737 af, Depth= 5.65"
 Routed to Pond 2P : S-1 Center WQ Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Type IA 24-hr Rainfall=5.89"

Area (ac)	CN	Description
* 5.810	98	Roads
5.810	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 1S: S-1 Center Basin

Hydrograph

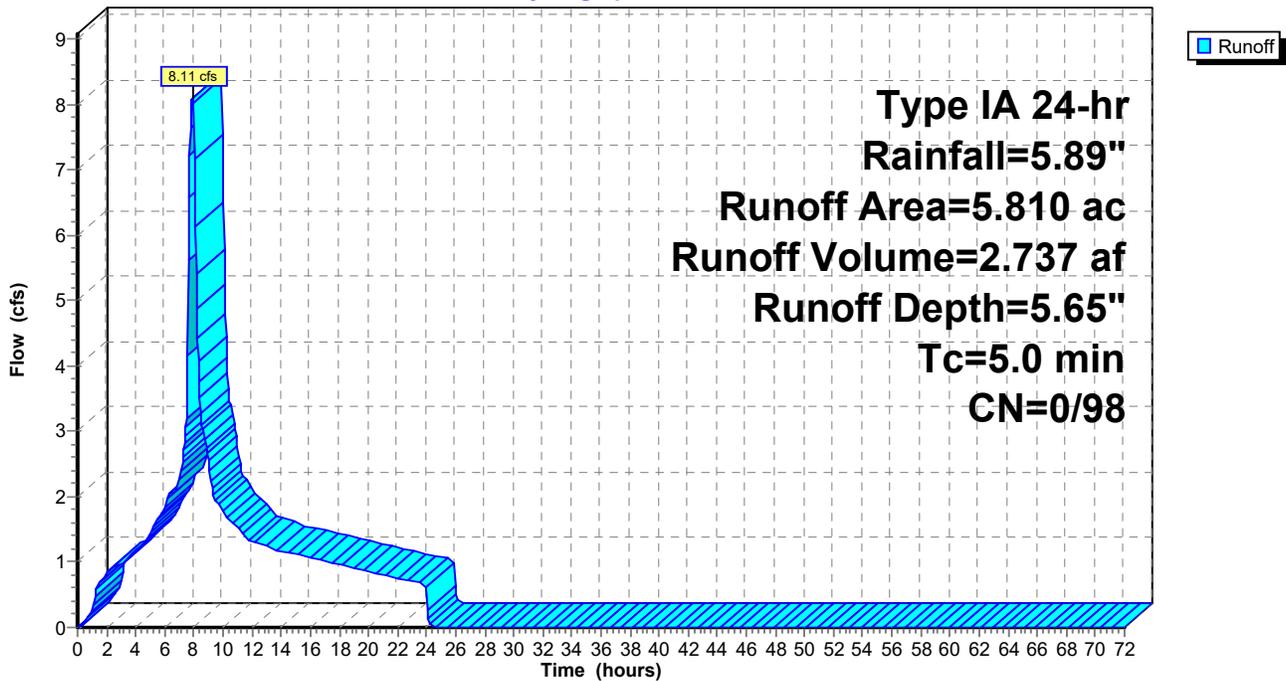

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 7

Hydrograph for Subcatchment 1S: S-1 Center Basin

Time (hours)	Precip. (inches)	Perv.Excess (inches)	Imp.Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	0.00
2.50	0.39	0.00	0.22	0.95
5.00	0.92	0.00	0.71	1.44
7.50	1.83	0.00	1.60	3.19
10.00	3.40	0.00	3.17	1.80
12.50	4.02	0.00	3.79	1.33
15.00	4.53	0.00	4.29	1.12
17.50	4.98	0.00	4.74	0.99
20.00	5.38	0.00	5.14	0.86
22.50	5.71	0.00	5.48	0.73
25.00	5.89	0.00	5.65	0.00
27.50	5.89	0.00	5.65	0.00
30.00	5.89	0.00	5.65	0.00
32.50	5.89	0.00	5.65	0.00
35.00	5.89	0.00	5.65	0.00
37.50	5.89	0.00	5.65	0.00
40.00	5.89	0.00	5.65	0.00
42.50	5.89	0.00	5.65	0.00
45.00	5.89	0.00	5.65	0.00
47.50	5.89	0.00	5.65	0.00
50.00	5.89	0.00	5.65	0.00
52.50	5.89	0.00	5.65	0.00
55.00	5.89	0.00	5.65	0.00
57.50	5.89	0.00	5.65	0.00
60.00	5.89	0.00	5.65	0.00
62.50	5.89	0.00	5.65	0.00
65.00	5.89	0.00	5.65	0.00
67.50	5.89	0.00	5.65	0.00
70.00	5.89	0.00	5.65	0.00

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 8

Summary for Subcatchment 4S: S-1 East Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 4.19 cfs @ 7.89 hrs, Volume= 1.413 af, Depth= 5.65"
 Routed to Pond 5P : S-1 East WQ Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Type IA 24-hr Rainfall=5.89"

Area (ac)	CN	Description
* 3.000	98	Roads
3.000	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 4S: S-1 East Basin

Hydrograph

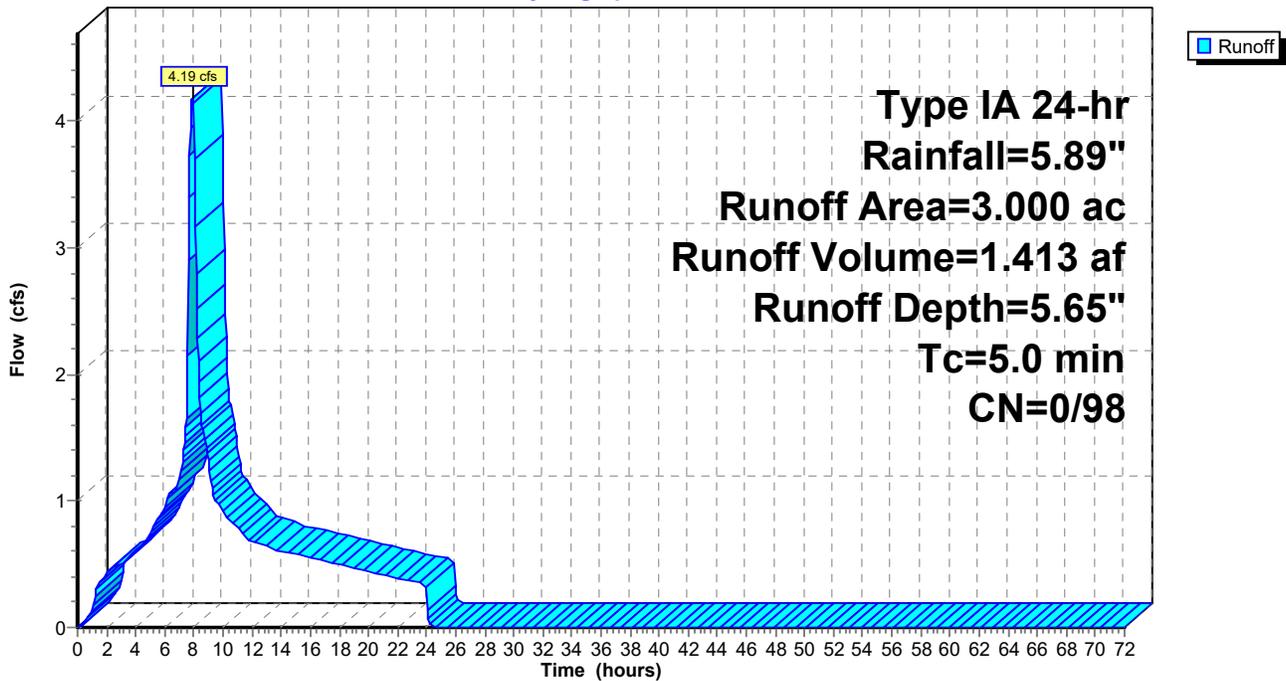

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 9

Hydrograph for Subcatchment 4S: S-1 East Basin

Time (hours)	Precip. (inches)	Perv.Excess (inches)	Imp.Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	0.00
2.50	0.39	0.00	0.22	0.49
5.00	0.92	0.00	0.71	0.75
7.50	1.83	0.00	1.60	1.65
10.00	3.40	0.00	3.17	0.93
12.50	4.02	0.00	3.79	0.69
15.00	4.53	0.00	4.29	0.58
17.50	4.98	0.00	4.74	0.51
20.00	5.38	0.00	5.14	0.45
22.50	5.71	0.00	5.48	0.38
25.00	5.89	0.00	5.65	0.00
27.50	5.89	0.00	5.65	0.00
30.00	5.89	0.00	5.65	0.00
32.50	5.89	0.00	5.65	0.00
35.00	5.89	0.00	5.65	0.00
37.50	5.89	0.00	5.65	0.00
40.00	5.89	0.00	5.65	0.00
42.50	5.89	0.00	5.65	0.00
45.00	5.89	0.00	5.65	0.00
47.50	5.89	0.00	5.65	0.00
50.00	5.89	0.00	5.65	0.00
52.50	5.89	0.00	5.65	0.00
55.00	5.89	0.00	5.65	0.00
57.50	5.89	0.00	5.65	0.00
60.00	5.89	0.00	5.65	0.00
62.50	5.89	0.00	5.65	0.00
65.00	5.89	0.00	5.65	0.00
67.50	5.89	0.00	5.65	0.00
70.00	5.89	0.00	5.65	0.00

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 10

Summary for Subcatchment 6S: S-1 South Basin

[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 1.47 cfs @ 7.89 hrs, Volume= 0.495 af, Depth= 5.65"
 Routed to Pond 7P : S-1 South WQ Bioretention Area


Runoff by SBUH method, Split Pervious/Imperv., Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Type IA 24-hr Rainfall=5.89"

Area (ac)	CN	Description
* 1.050	98	Roads
1.050	98	100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.0					Direct Entry, Tc

Subcatchment 6S: S-1 South Basin

Hydrograph

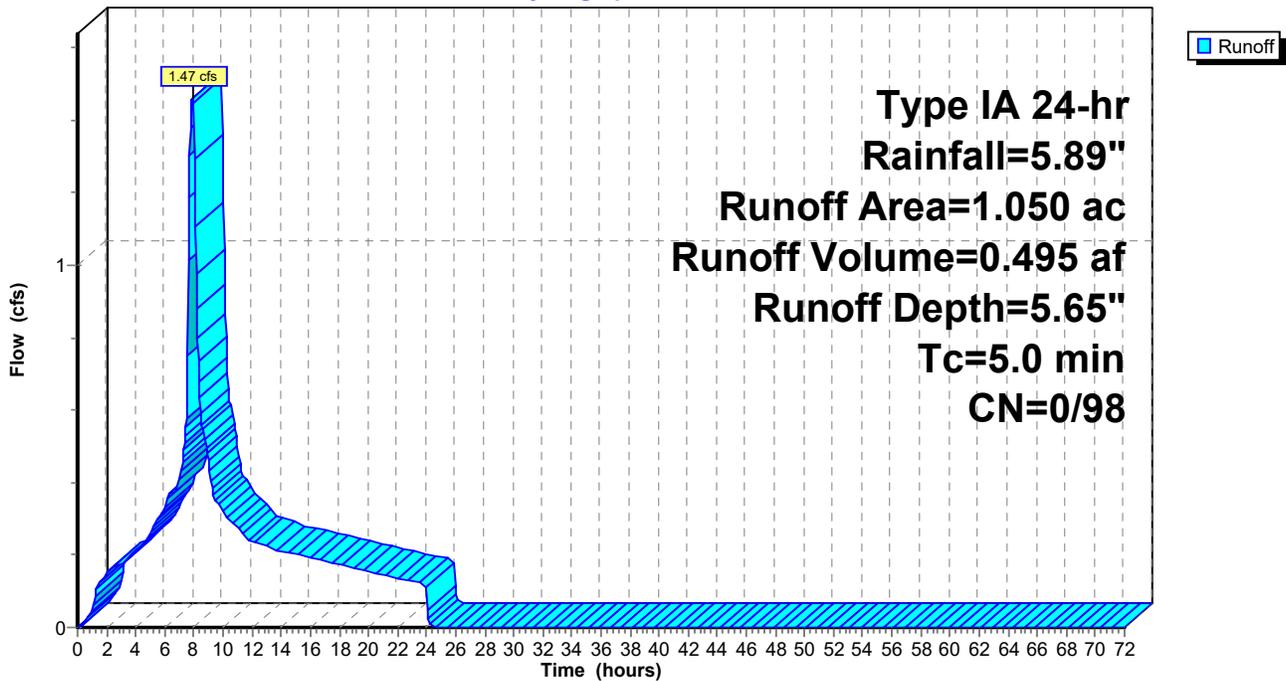

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 11

Hydrograph for Subcatchment 6S: S-1 South Basin

Time (hours)	Precip. (inches)	Perv.Excess (inches)	Imp.Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	0.00
2.50	0.39	0.00	0.22	0.17
5.00	0.92	0.00	0.71	0.26
7.50	1.83	0.00	1.60	0.58
10.00	3.40	0.00	3.17	0.33
12.50	4.02	0.00	3.79	0.24
15.00	4.53	0.00	4.29	0.20
17.50	4.98	0.00	4.74	0.18
20.00	5.38	0.00	5.14	0.16
22.50	5.71	0.00	5.48	0.13
25.00	5.89	0.00	5.65	0.00
27.50	5.89	0.00	5.65	0.00
30.00	5.89	0.00	5.65	0.00
32.50	5.89	0.00	5.65	0.00
35.00	5.89	0.00	5.65	0.00
37.50	5.89	0.00	5.65	0.00
40.00	5.89	0.00	5.65	0.00
42.50	5.89	0.00	5.65	0.00
45.00	5.89	0.00	5.65	0.00
47.50	5.89	0.00	5.65	0.00
50.00	5.89	0.00	5.65	0.00
52.50	5.89	0.00	5.65	0.00
55.00	5.89	0.00	5.65	0.00
57.50	5.89	0.00	5.65	0.00
60.00	5.89	0.00	5.65	0.00
62.50	5.89	0.00	5.65	0.00
65.00	5.89	0.00	5.65	0.00
67.50	5.89	0.00	5.65	0.00
70.00	5.89	0.00	5.65	0.00

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 12

Summary for Pond 2P: S-1 Center WQ Bioretention Area

Inflow Area = 5.810 ac, 100.00% Impervious, Inflow Depth = 5.65"
Inflow = 8.11 cfs @ 7.89 hrs, Volume= 2.737 af
Outflow = 7.92 cfs @ 7.98 hrs, Volume= 2.737 af, Atten= 2%, Lag= 5.4 min
Discarded = 0.48 cfs @ 7.98 hrs, Volume= 0.995 af
Primary = 7.45 cfs @ 7.98 hrs, Volume= 1.742 af
Routed to Pond 3P : S-1 Center Infiltration Pond

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
Peak Elev= 101.51' @ 7.98 hrs Surf.Area= 0.158 ac Storage= 0.212 af

Plug-Flow detention time= 77.3 min calculated for 2.735 af (100% of inflow)
Center-of-Mass det. time= 77.4 min (730.2 - 652.8)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.476 af	102.00'W x 53.00'L x 3.00'H Prismatic Z=3.0

Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.48 cfs @ 7.98 hrs HW=101.51' (Free Discharge)
↑**2=Exfiltration** (Exfiltration Controls 0.48 cfs)

Primary OutFlow Max=7.42 cfs @ 7.98 hrs HW=101.51' (Free Discharge)
↑**1=Orifice/Grate** (Weir Controls 7.42 cfs @ 2.33 fps)

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC


Type IA 24-hr Rainfall=5.89"

Printed 11/13/2024

Page 13

Pond 2P: S-1 Center WQ Bioretention Area

Hydrograph

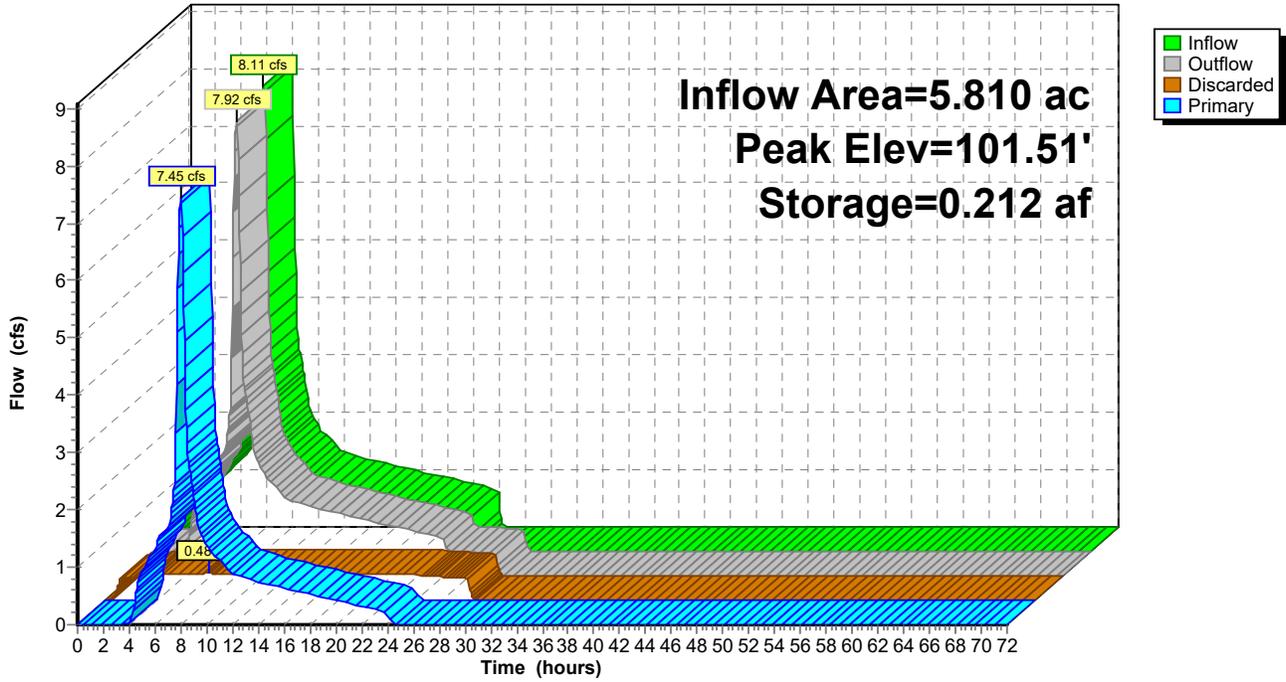

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 14

Hydrograph for Pond 2P: S-1 Center WQ Bioretention Area

Time (hours)	Inflow (cfs)	Storage (acre-feet)	Elevation (feet)	Outflow (cfs)	Discarded (cfs)	Primary (cfs)
0.00	0.00	0.000	100.00	0.00	0.00	0.00
2.50	0.95	0.046	100.36	0.40	0.40	0.00
5.00	1.44	0.154	101.13	1.37	0.45	0.92
7.50	3.19	0.171	101.24	2.91	0.46	2.45
10.00	1.80	0.160	101.17	1.85	0.45	1.40
12.50	1.33	0.153	101.12	1.31	0.45	0.86
15.00	1.12	0.150	101.10	1.13	0.45	0.68
17.50	0.99	0.148	101.09	1.00	0.45	0.55
20.00	0.86	0.146	101.08	0.87	0.45	0.43
22.50	0.73	0.144	101.06	0.74	0.45	0.30
25.00	0.00	0.109	100.82	0.43	0.43	0.00
27.50	0.00	0.025	100.19	0.39	0.39	0.00
30.00	0.00	0.000	100.00	0.00	0.00	0.00
32.50	0.00	0.000	100.00	0.00	0.00	0.00
35.00	0.00	0.000	100.00	0.00	0.00	0.00
37.50	0.00	0.000	100.00	0.00	0.00	0.00
40.00	0.00	0.000	100.00	0.00	0.00	0.00
42.50	0.00	0.000	100.00	0.00	0.00	0.00
45.00	0.00	0.000	100.00	0.00	0.00	0.00
47.50	0.00	0.000	100.00	0.00	0.00	0.00
50.00	0.00	0.000	100.00	0.00	0.00	0.00
52.50	0.00	0.000	100.00	0.00	0.00	0.00
55.00	0.00	0.000	100.00	0.00	0.00	0.00
57.50	0.00	0.000	100.00	0.00	0.00	0.00
60.00	0.00	0.000	100.00	0.00	0.00	0.00
62.50	0.00	0.000	100.00	0.00	0.00	0.00
65.00	0.00	0.000	100.00	0.00	0.00	0.00
67.50	0.00	0.000	100.00	0.00	0.00	0.00
70.00	0.00	0.000	100.00	0.00	0.00	0.00

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 15

Summary for Pond 3P: S-1 Center Infiltration Pond

Inflow Area = 9.860 ac, 100.00% Impervious, Inflow Depth = 3.63"
Inflow = 12.74 cfs @ 7.97 hrs, Volume= 2.987 af
Outflow = 1.34 cfs @ 13.53 hrs, Volume= 2.987 af, Atten= 89%, Lag= 333.1 min
Discarded = 1.34 cfs @ 13.53 hrs, Volume= 2.987 af
Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
Peak Elev= 5.87' @ 13.53 hrs Surf.Area= 0.332 ac Storage= 1.432 af

Plug-Flow detention time= 569.4 min calculated for 2.987 af (100% of inflow)
Center-of-Mass det. time= 569.3 min (1,219.1 - 649.8)

Volume	Invert	Avail.Storage	Storage Description
#1	0.00'	1.829 af	85.00'W x 85.00'L x 7.00'H Prismatic Z=3.0

Device	Routing	Invert	Outlet Devices
#1	Primary	6.00'	24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	0.00'	4.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=1.34 cfs @ 13.53 hrs HW=5.87' (Free Discharge)
↑**2=Exfiltration** (Exfiltration Controls 1.34 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=0.00' (Free Discharge)
↑**1=Orifice/Grate** (Controls 0.00 cfs)

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC


Type IA 24-hr Rainfall=5.89"

Printed 11/13/2024

Page 16

Pond 3P: S-1 Center Infiltration Pond

Hydrograph

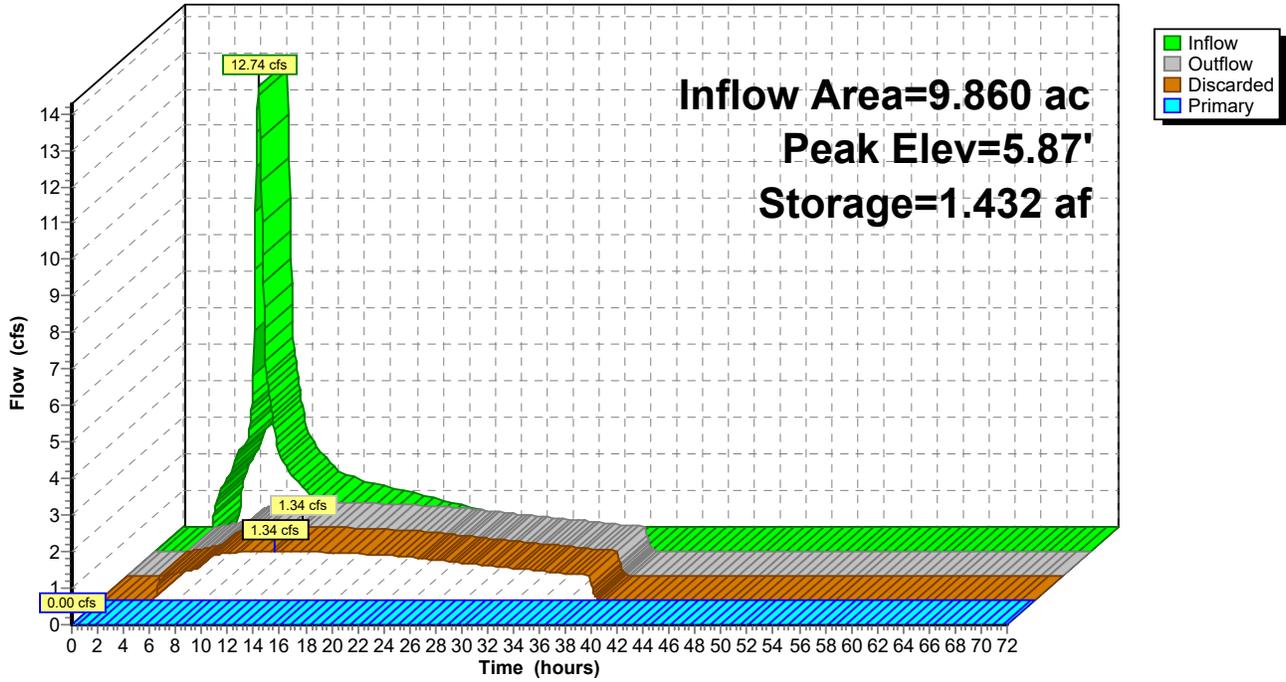

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 17

Hydrograph for Pond 3P: S-1 Center Infiltration Pond

Time (hours)	Inflow (cfs)	Storage (acre-feet)	Elevation (feet)	Outflow (cfs)	Discarded (cfs)	Primary (cfs)
0.00	0.00	0.000	0.00	0.00	0.00	0.00
2.50	0.00	0.000	0.00	0.00	0.00	0.00
5.00	1.61	0.036	0.21	0.69	0.69	0.00
7.50	4.27	0.402	2.10	0.88	0.88	0.00
10.00	2.38	1.327	5.55	1.30	1.30	0.00
12.50	1.48	1.427	5.85	1.34	1.34	0.00
15.00	1.18	1.421	5.83	1.33	1.33	0.00
17.50	0.96	1.368	5.67	1.31	1.31	0.00
20.00	0.74	1.275	5.38	1.27	1.27	0.00
22.50	0.52	1.147	4.97	1.22	1.22	0.00
25.00	0.00	0.963	4.34	1.14	1.14	0.00
27.50	0.00	0.737	3.51	1.04	1.04	0.00
30.00	0.00	0.532	2.67	0.95	0.95	0.00
32.50	0.00	0.346	1.84	0.85	0.85	0.00
35.00	0.00	0.179	1.01	0.77	0.77	0.00
37.50	0.00	0.029	0.17	0.69	0.69	0.00
40.00	0.00	0.000	0.00	0.00	0.00	0.00
42.50	0.00	0.000	0.00	0.00	0.00	0.00
45.00	0.00	0.000	0.00	0.00	0.00	0.00
47.50	0.00	0.000	0.00	0.00	0.00	0.00
50.00	0.00	0.000	0.00	0.00	0.00	0.00
52.50	0.00	0.000	0.00	0.00	0.00	0.00
55.00	0.00	0.000	0.00	0.00	0.00	0.00
57.50	0.00	0.000	0.00	0.00	0.00	0.00
60.00	0.00	0.000	0.00	0.00	0.00	0.00
62.50	0.00	0.000	0.00	0.00	0.00	0.00
65.00	0.00	0.000	0.00	0.00	0.00	0.00
67.50	0.00	0.000	0.00	0.00	0.00	0.00
70.00	0.00	0.000	0.00	0.00	0.00	0.00

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 18

Summary for Pond 5P: S-1 East WQ Bioretention Area

Inflow Area = 3.000 ac, 100.00% Impervious, Inflow Depth = 5.65"
 Inflow = 4.19 cfs @ 7.89 hrs, Volume= 1.413 af
 Outflow = 4.16 cfs @ 7.95 hrs, Volume= 1.413 af, Atten= 1%, Lag= 3.2 min
 Discarded = 0.22 cfs @ 1.25 hrs, Volume= 0.494 af
 Primary = 3.94 cfs @ 7.95 hrs, Volume= 0.919 af
 Routed to Pond 3P : S-1 Center Infiltration Pond

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Peak Elev= 101.33' @ 7.95 hrs Surf.Area= 0.072 ac Storage= 0.096 af

Plug-Flow detention time= 76.2 min calculated for 1.412 af (100% of inflow)
 Center-of-Mass det. time= 76.3 min (729.2 - 652.8)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.217 af	70.00'W x 45.00'L x 3.00'H Prismatic

Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.22 cfs @ 1.25 hrs HW=100.03' (Free Discharge)
 ↑**2=Exfiltration** (Exfiltration Controls 0.22 cfs)

Primary OutFlow Max=3.94 cfs @ 7.95 hrs HW=101.33' (Free Discharge)
 ↑**1=Orifice/Grate** (Weir Controls 3.94 cfs @ 1.88 fps)

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC


Type IA 24-hr Rainfall=5.89"

Printed 11/13/2024

Page 19

Pond 5P: S-1 East WQ Bioretention Area

Hydrograph

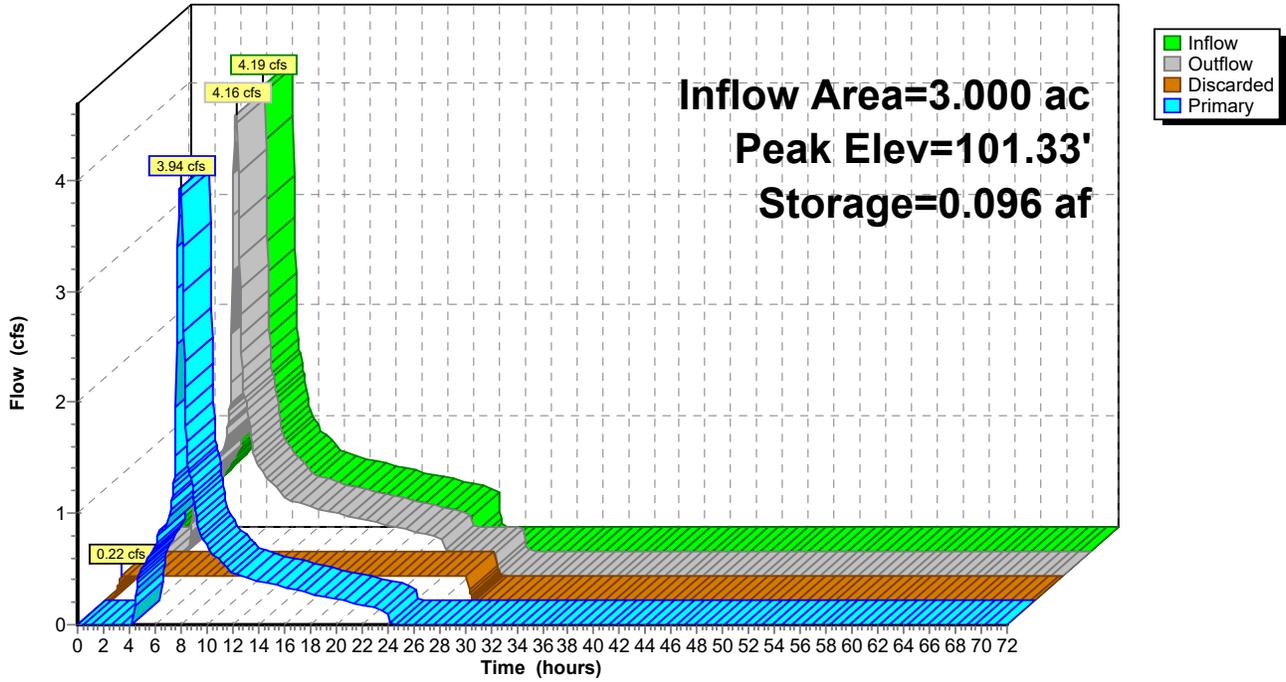

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 20

Hydrograph for Pond 5P: S-1 East WQ Bioretention Area

Time (hours)	Inflow (cfs)	Storage (acre-feet)	Elevation (feet)	Outflow (cfs)	Discarded (cfs)	Primary (cfs)
0.00	0.00	0.000	100.00	0.00	0.00	0.00
2.50	0.49	0.022	100.30	0.22	0.22	0.00
5.00	0.75	0.078	101.08	0.73	0.22	0.51
7.50	1.65	0.084	101.16	1.56	0.22	1.34
10.00	0.93	0.080	101.11	0.95	0.22	0.73
12.50	0.69	0.078	101.08	0.68	0.22	0.46
15.00	0.58	0.077	101.07	0.58	0.22	0.36
17.50	0.51	0.077	101.06	0.52	0.22	0.30
20.00	0.45	0.076	101.05	0.45	0.22	0.23
22.50	0.38	0.075	101.04	0.38	0.22	0.16
25.00	0.00	0.058	100.81	0.22	0.22	0.00
27.50	0.00	0.013	100.18	0.22	0.22	0.00
30.00	0.00	0.000	100.00	0.00	0.00	0.00
32.50	0.00	0.000	100.00	0.00	0.00	0.00
35.00	0.00	0.000	100.00	0.00	0.00	0.00
37.50	0.00	0.000	100.00	0.00	0.00	0.00
40.00	0.00	0.000	100.00	0.00	0.00	0.00
42.50	0.00	0.000	100.00	0.00	0.00	0.00
45.00	0.00	0.000	100.00	0.00	0.00	0.00
47.50	0.00	0.000	100.00	0.00	0.00	0.00
50.00	0.00	0.000	100.00	0.00	0.00	0.00
52.50	0.00	0.000	100.00	0.00	0.00	0.00
55.00	0.00	0.000	100.00	0.00	0.00	0.00
57.50	0.00	0.000	100.00	0.00	0.00	0.00
60.00	0.00	0.000	100.00	0.00	0.00	0.00
62.50	0.00	0.000	100.00	0.00	0.00	0.00
65.00	0.00	0.000	100.00	0.00	0.00	0.00
67.50	0.00	0.000	100.00	0.00	0.00	0.00
70.00	0.00	0.000	100.00	0.00	0.00	0.00

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 21

Summary for Pond 7P: S-1 South WQ Bioretention Area

Inflow Area = 1.050 ac, 100.00% Impervious, Inflow Depth = 5.65"
 Inflow = 1.47 cfs @ 7.89 hrs, Volume= 0.495 af
 Outflow = 1.46 cfs @ 7.92 hrs, Volume= 0.495 af, Atten= 0%, Lag= 1.5 min
 Discarded = 0.07 cfs @ 1.25 hrs, Volume= 0.169 af
 Primary = 1.39 cfs @ 7.92 hrs, Volume= 0.326 af
 Routed to Pond 3P : S-1 Center Infiltration Pond

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.05 hrs
 Peak Elev= 101.17' @ 7.92 hrs Surf.Area= 0.025 ac Storage= 0.029 af

Plug-Flow detention time= 72.2 min calculated for 0.494 af (100% of inflow)
 Center-of-Mass det. time= 72.3 min (725.1 - 652.8)

Volume	Invert	Avail.Storage	Storage Description
#1	100.00'	0.074 af	90.00'W x 12.00'L x 3.00'H Prismatic

Device	Routing	Invert	Outlet Devices
#1	Primary	101.00'	24.0" Horiz. Orifice/Grate C= 0.600 Limited to weir flow at low heads
#2	Discarded	100.00'	3.000 in/hr Exfiltration over Surface area

Discarded OutFlow Max=0.07 cfs @ 1.25 hrs HW=100.03' (Free Discharge)
 ↳ **2=Exfiltration** (Exfiltration Controls 0.07 cfs)

Primary OutFlow Max=1.38 cfs @ 7.92 hrs HW=101.17' (Free Discharge)
 ↳ **1=Orifice/Grate** (Weir Controls 1.38 cfs @ 1.33 fps)

S-1 Bioretention & Infiltration Ponds Connected

Prepared by Core Design

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC


Type IA 24-hr Rainfall=5.89"

Printed 11/13/2024

Page 22

Pond 7P: S-1 South WQ Bioretention Area

Hydrograph

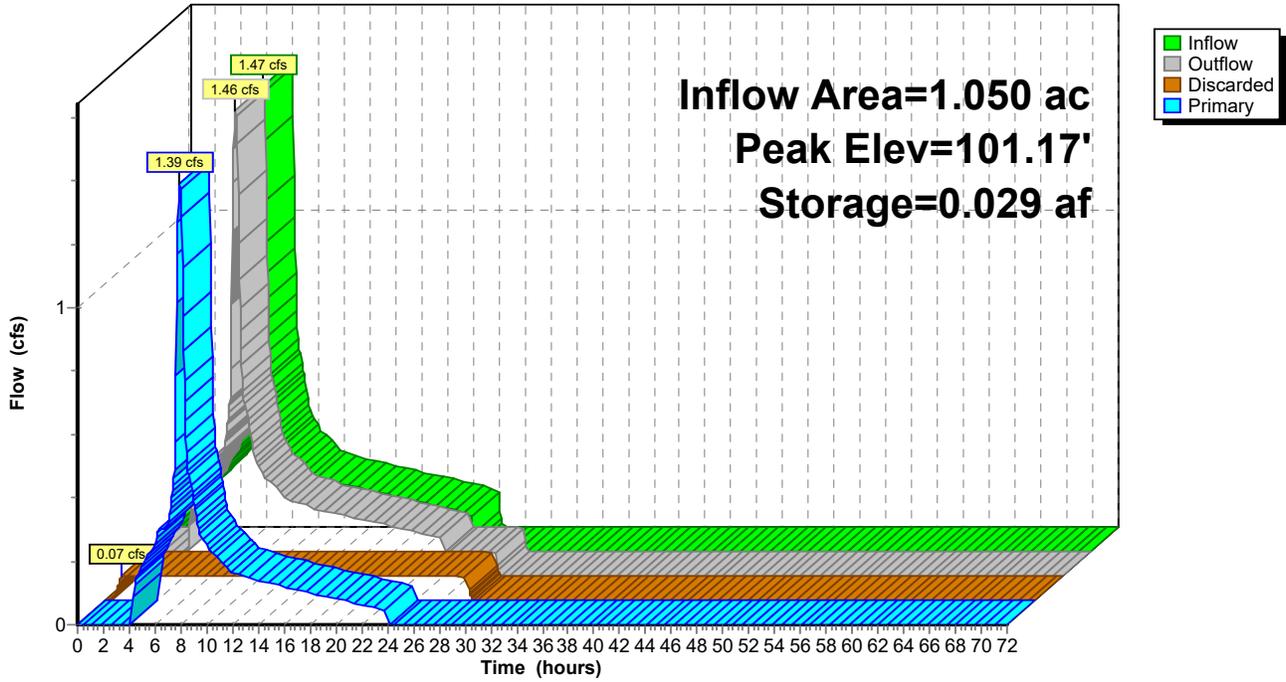

S-1 Bioretention & Infiltration Ponds Connected

Type IA 24-hr Rainfall=5.89"

Prepared by Core Design

Printed 11/13/2024

HydroCAD® 10.20-5c s/n 12748 © 2023 HydroCAD Software Solutions LLC

Page 23

Hydrograph for Pond 7P: S-1 South WQ Bioretention Area

Time (hours)	Inflow (cfs)	Storage (acre-feet)	Elevation (feet)	Outflow (cfs)	Discarded (cfs)	Primary (cfs)
0.00	0.00	0.000	100.00	0.00	0.00	0.00
2.50	0.17	0.008	100.31	0.07	0.07	0.00
5.00	0.26	0.026	101.04	0.26	0.07	0.18
7.50	0.58	0.027	101.08	0.56	0.07	0.49
10.00	0.33	0.026	101.05	0.33	0.07	0.25
12.50	0.24	0.026	101.04	0.24	0.07	0.16
15.00	0.20	0.026	101.03	0.20	0.07	0.13
17.50	0.18	0.025	101.03	0.18	0.07	0.11
20.00	0.16	0.025	101.02	0.16	0.07	0.08
22.50	0.13	0.025	101.02	0.13	0.07	0.06
25.00	0.00	0.020	100.79	0.07	0.07	0.00
27.50	0.00	0.004	100.17	0.07	0.07	0.00
30.00	0.00	0.000	100.00	0.00	0.00	0.00
32.50	0.00	0.000	100.00	0.00	0.00	0.00
35.00	0.00	0.000	100.00	0.00	0.00	0.00
37.50	0.00	0.000	100.00	0.00	0.00	0.00
40.00	0.00	0.000	100.00	0.00	0.00	0.00
42.50	0.00	0.000	100.00	0.00	0.00	0.00
45.00	0.00	0.000	100.00	0.00	0.00	0.00
47.50	0.00	0.000	100.00	0.00	0.00	0.00
50.00	0.00	0.000	100.00	0.00	0.00	0.00
52.50	0.00	0.000	100.00	0.00	0.00	0.00
55.00	0.00	0.000	100.00	0.00	0.00	0.00
57.50	0.00	0.000	100.00	0.00	0.00	0.00
60.00	0.00	0.000	100.00	0.00	0.00	0.00
62.50	0.00	0.000	100.00	0.00	0.00	0.00
65.00	0.00	0.000	100.00	0.00	0.00	0.00
67.50	0.00	0.000	100.00	0.00	0.00	0.00
70.00	0.00	0.000	100.00	0.00	0.00	0.00